

Report No.: PKS190411002-10

Test Time: 2019-4-17 12:50

## Luminaire Property


Luminaire Manufacturer:  
Luminaire Category:  
Luminaire Description: DS73V4XX  
Lamp Description:  
Lumens per Lamp:  
Luminous Width (mm):  
Voltage: 120.0 V  
Power: 42.60 W

Lamp Catalog:  
Number of Lamps:  
Luminous Length (mm):  
Luminous Height (mm):  
Current: 0.358 A  
Power Factor: 0.993


## Photometric Results

CIE Class: General Diffuse	Total Rated Lamp Lumens: 3501.5 lm
Measurement Flux: 3501.5 lm	Efficiency: 100%
Downward Ratio: 50%	Upward Ratio: 50%
Field Angle(C0/C180,C90/C270,C45/C225,C135/315): 360.0, 360.0, 360.0, 360.0	
Beam Angle(C0/C180,C90/C270,C45/C225,C135/315): 360.0, 182.8, 180.0, 172.8	
Luminaire Efficacy Rating (LER): 82.24	C0r0 Intensity: 242.4 cd
Max. Intensity: 723.3 cd	Pos of Max. Intensity: H90 V110
S/MH(C0/C180): 1.28	S/MH(C90/C270): 2.23

Picture Of Luminaire



Luminous Intensity Distribution Curve

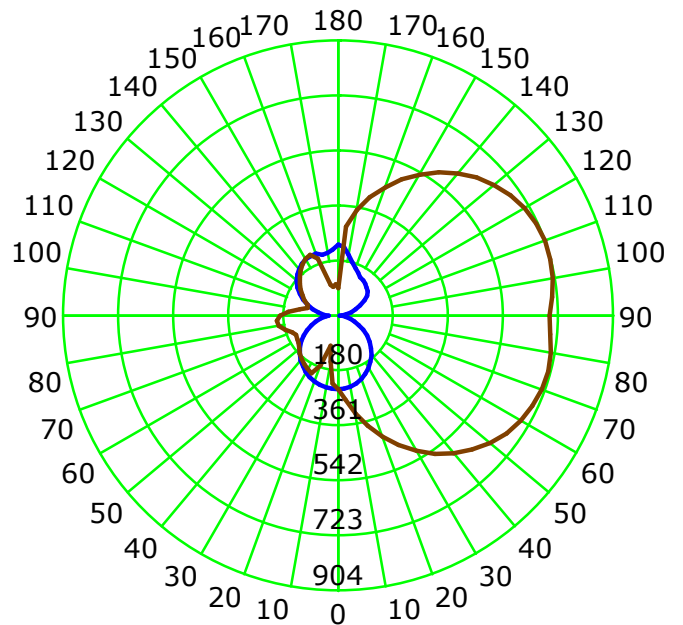

Unit: cd



Average Diffuse Angle(50%): 271.4°

— C0-C180 — C90-C270

C Plane (°):0.0-360.0: 22.5  
Test Lab: Bacl  
Test Type: TYPE C  
Temperature: 24.8 °C  
Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0  
Test Device: GPM-3000  
Distance: 14.073 m  
Humidity: 48  
Inspector:


## Luminous Intensity Distribution Curve

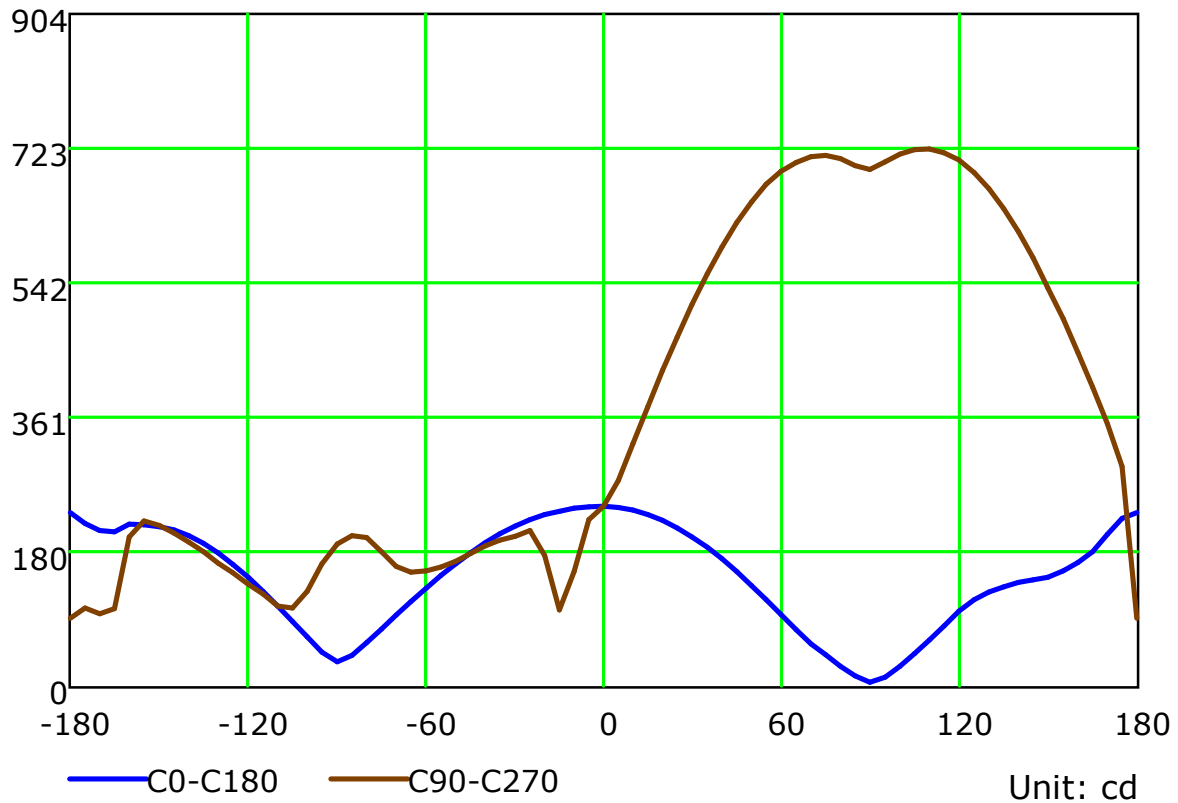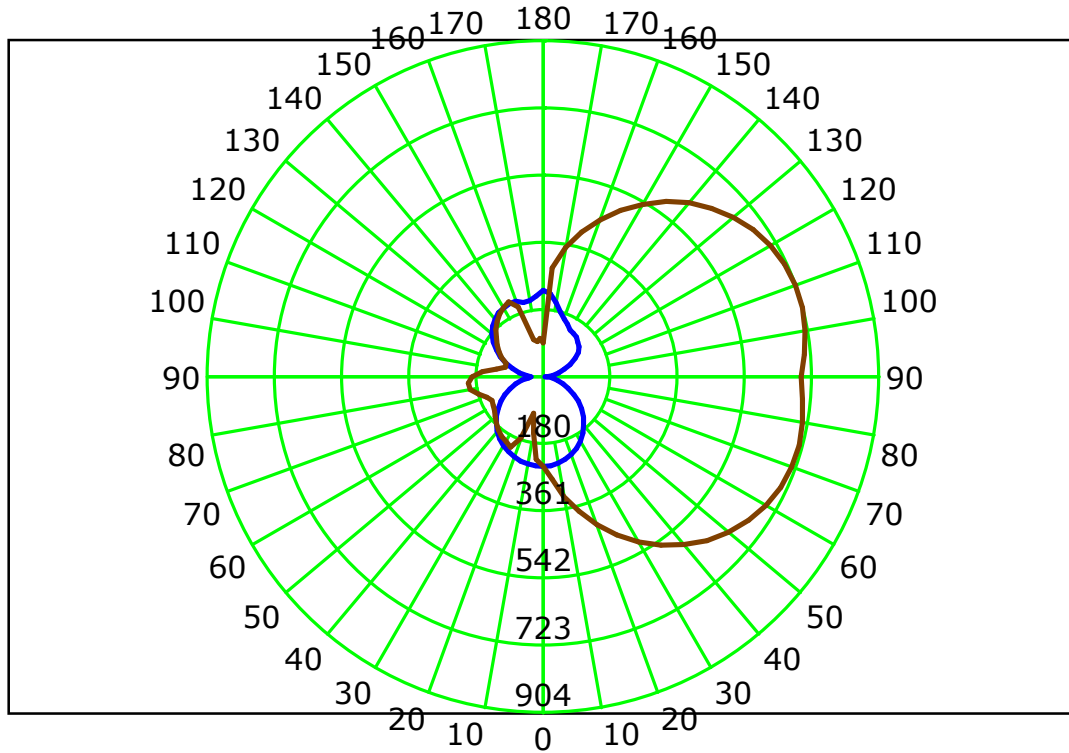

C Plane (°):0.0-360.0: 22.5  
 Test Lab: Bacl  
 Test Type: TYPE C  
 Temperature: 24.8 'C  
 Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0  
 Test Device: GPM-3000  
 Distance: 14.073 m  
 Humidity: 48  
 Inspector:

## Luminous Intensity Distribution Curve(cd/klm)

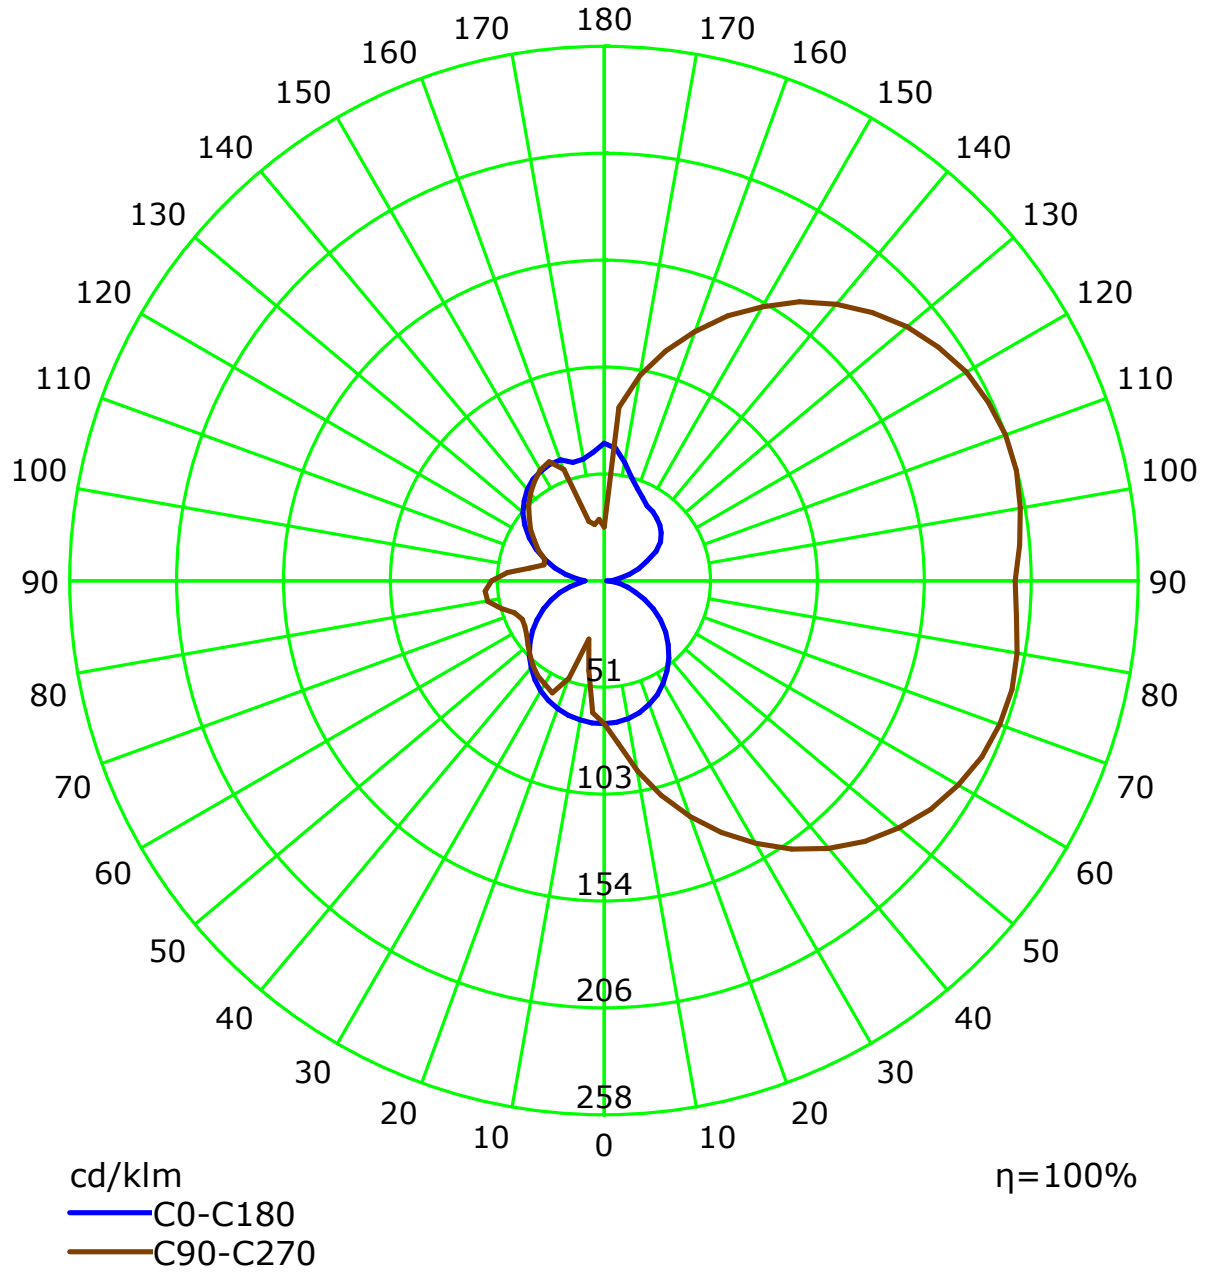


C Plane (°):0.0-360.0: 22.5  
 Test Lab: Bacl  
 Test Type: TYPE C  
 Temperature: 24.8 °C  
 Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0  
 Test Device: GPM-3000  
 Distance: 14.073 m  
 Humidity: 48  
 Inspector:

## Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	1.07	1.07	1.07	1.07	.99	.99	.99	.99	.83	.83	.83	.69	.69	.69	.56	.56	.56	.50
1	.94	.88	.82	.77	.86	.80	.76	.71	.67	.63	.60	.55	.52	.49	.43	.41	.39	.34
2	.84	.74	.66	.60	.76	.68	.61	.55	.56	.51	.46	.46	.42	.38	.36	.33	.30	.25
3	.75	.64	.55	.48	.69	.59	.51	.44	.48	.42	.37	.39	.34	.30	.30	.27	.24	.19
4	.68	.56	.47	.39	.62	.51	.43	.36	.42	.36	.31	.34	.29	.25	.26	.23	.19	.16
5	.62	.49	.40	.33	.57	.45	.37	.31	.37	.31	.26	.30	.25	.21	.23	.19	.16	.13
6	.57	.44	.35	.28	.52	.40	.32	.26	.33	.27	.22	.27	.22	.18	.21	.17	.14	.11
7	.53	.39	.30	.24	.48	.36	.28	.22	.30	.23	.19	.24	.19	.15	.19	.15	.12	.09
8	.49	.35	.27	.21	.44	.32	.25	.19	.27	.21	.16	.22	.17	.13	.17	.13	.10	.08
9	.45	.32	.24	.18	.41	.29	.22	.17	.25	.19	.14	.20	.15	.12	.16	.12	.09	.07
10	.42	.29	.21	.16	.38	.27	.20	.15	.23	.17	.13	.18	.14	.10	.15	.11	.08	.06


Spacing Criteria (0-180): 1.28  
 Spacing Criteria (90-270): 2.23  
 Spacing Criteria (Diagonal): 1.98

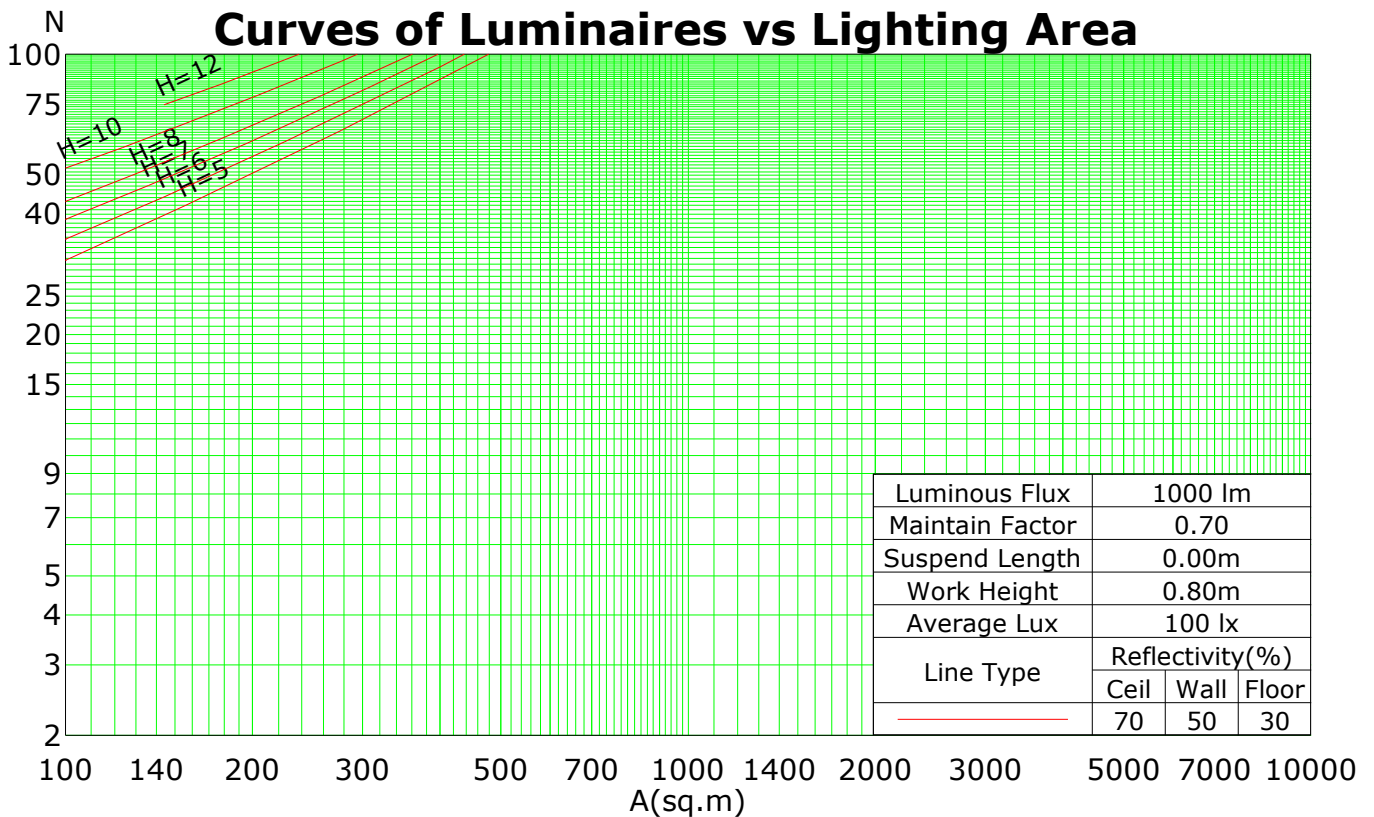

C Plane (°):0.0-360.0: 22.5  
 Test Lab: Bacl  
 Test Type: TYPE C  
 Temperature: 24.8 'C  
 Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0  
 Test Device: GPM-3000  
 Distance: 14.073 m  
 Humidity: 48  
 Inspector:

## IsoLux Plot

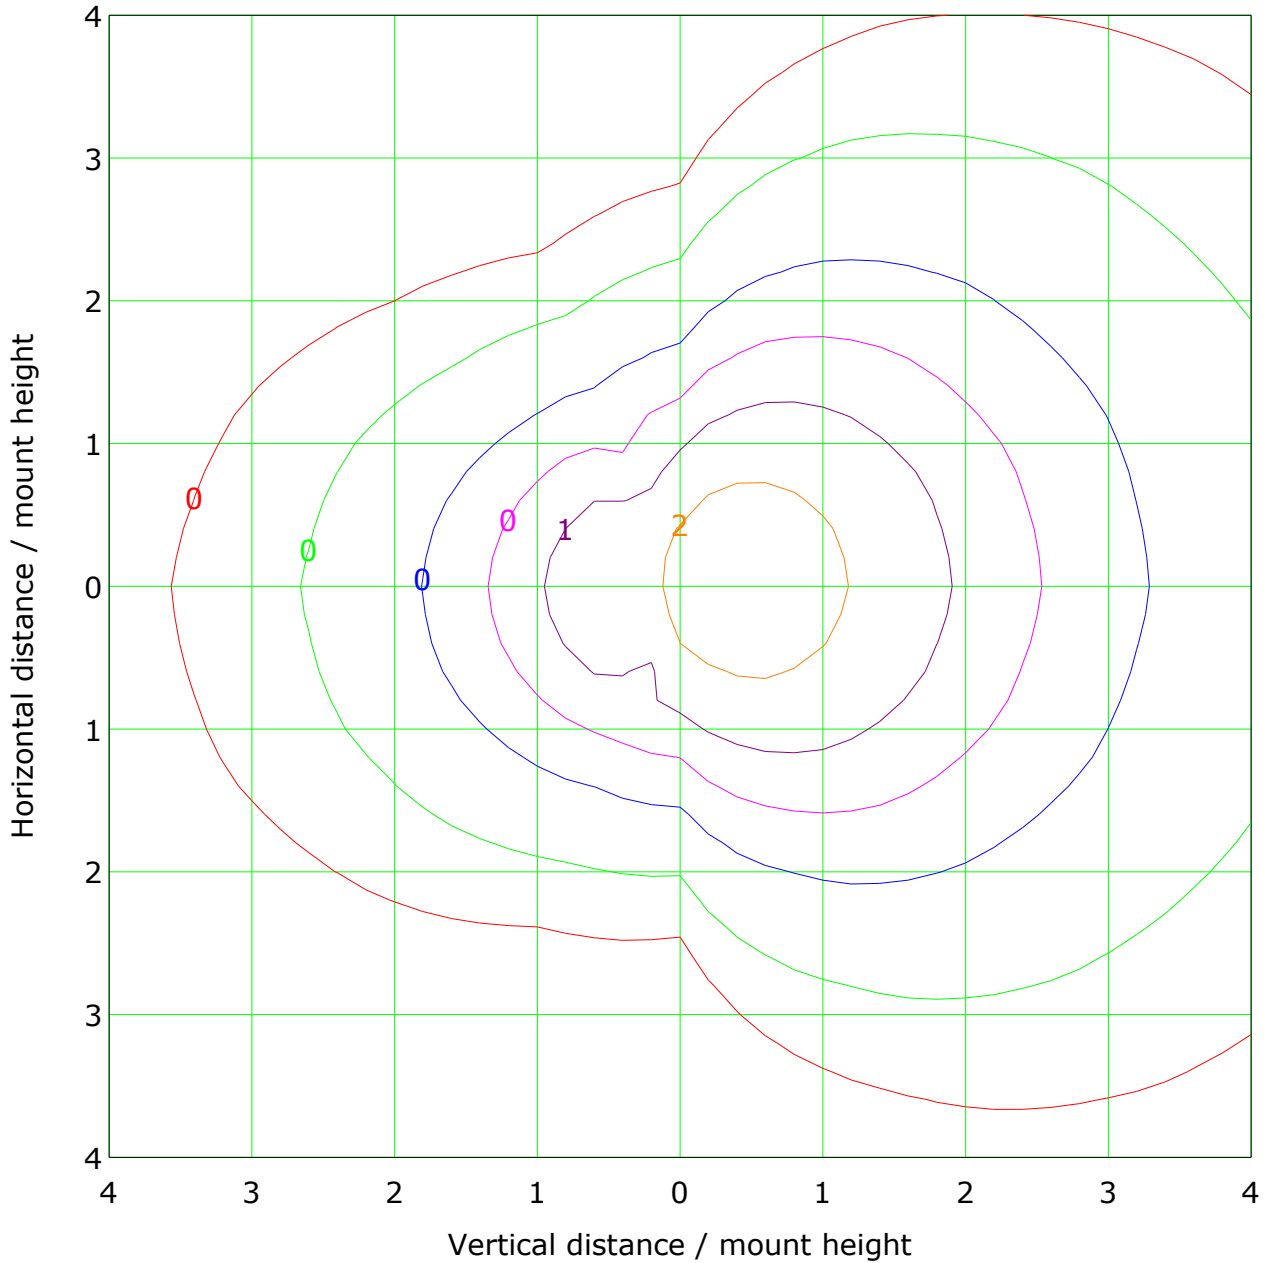

Mounting Height: 10.0m    Max Lux(100%): 3.5 lx

— ( 1%): 0.0 lx	— ( 2%): 0.1 lx
— ( 5%): 0.2 lx	— ( 10%): 0.4 lx
— ( 20%): 0.7 lx	— ( 50%): 1.8 lx



C Plane (°):0.0-360.0: 22.5  
 Test Lab: Bacl  
 Test Type: TYPE C  
 Temperature: 24.8 'C  
 Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0  
 Test Device: GPM-3000  
 Distance: 14.073 m  
 Humidity: 48  
 Inspector:

## Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
		2000	1000	500	<=300				
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

a b c d e f g h

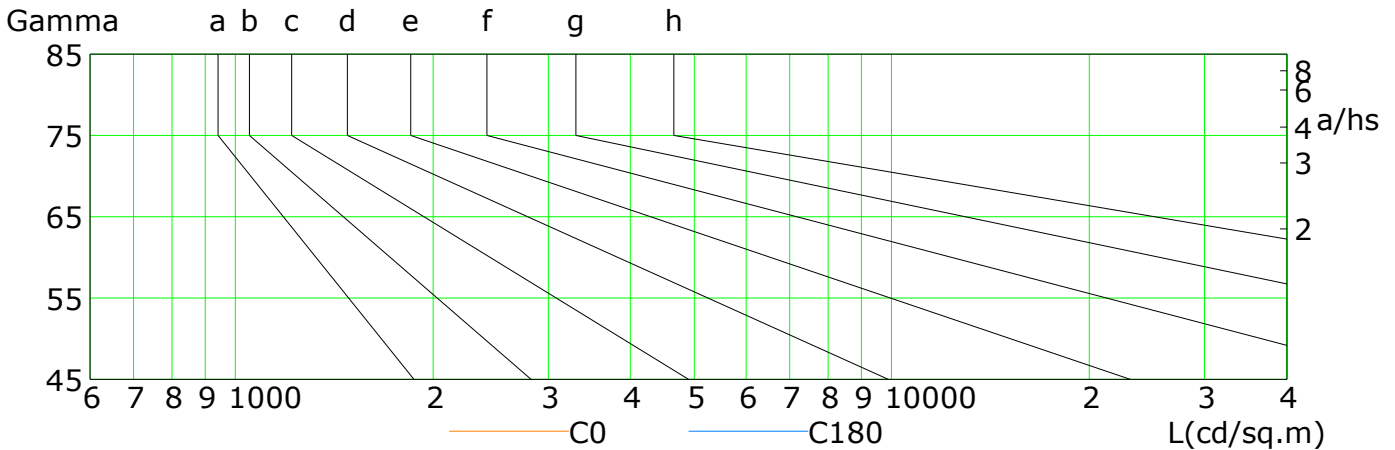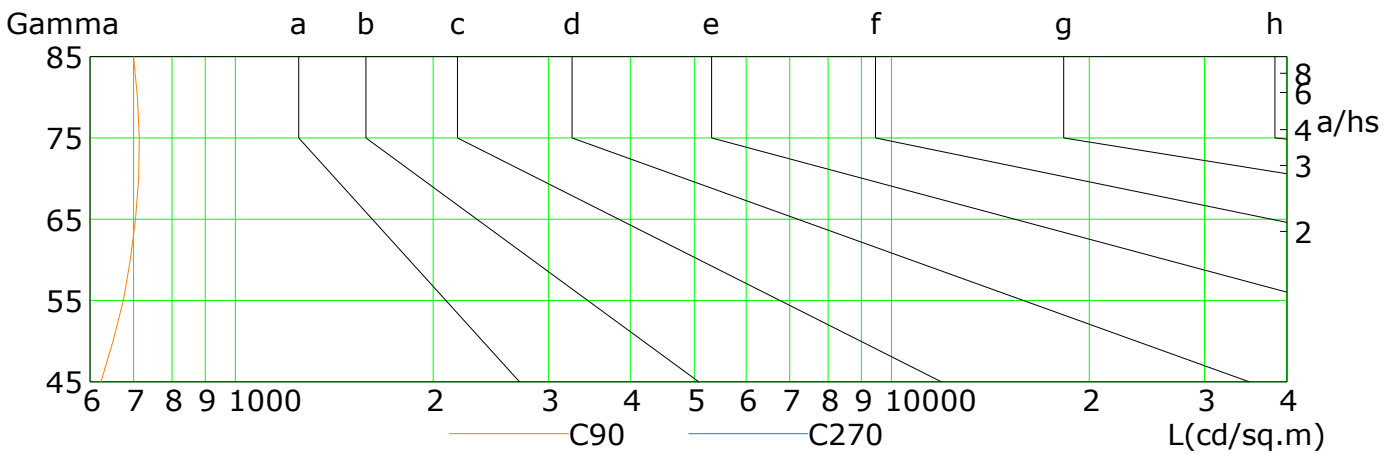


L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	154	136	117	97	76	57	42	27	14
C90	624	651	675	693	705	712	714	710	700
C180	180	165	149	132	114	96	77	59	41
C270	179	169	160	156	154	161	181	200	203

C Plane (°):0.0-360.0: 22.5  
Test Lab: Bacl  
Test Type: TYPE C  
Temperature: 24.8 'C  
Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0  
Test Device: GPM-3000  
Distance: 14.073 m  
Humidity: 48  
Inspector:


## Illuminance at a Distance

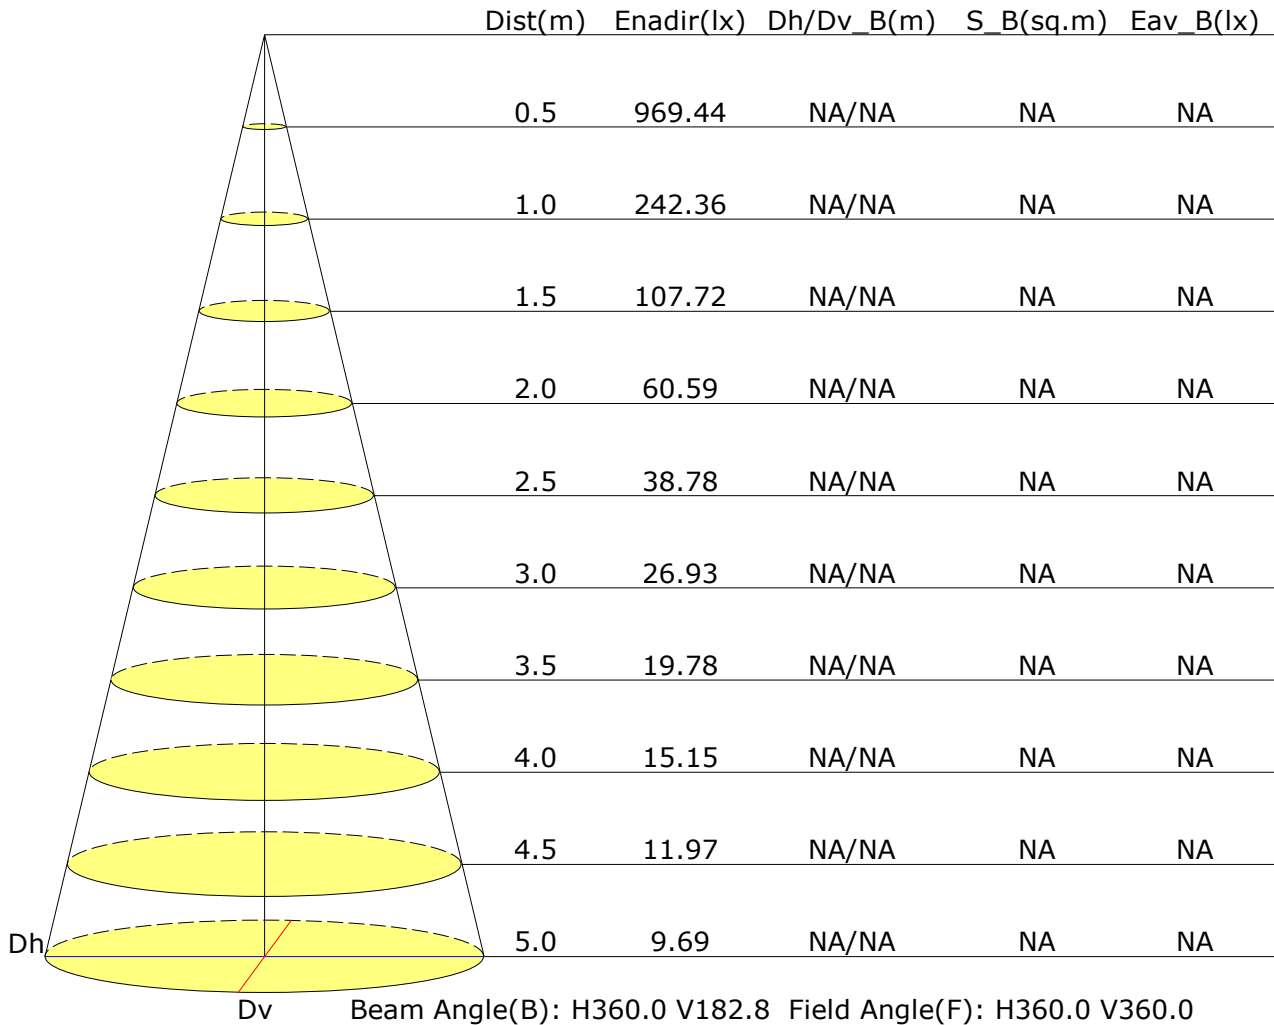

C Plane (°):0.0-360.0: 22.5  
 Test Lab: Bacl  
 Test Type: TYPE C  
 Temperature: 24.8 'C  
 Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0  
 Test Device: GPM-3000  
 Distance: 14.073 m  
 Humidity: 48  
 Inspector:

## Vertical IsoLux Plot

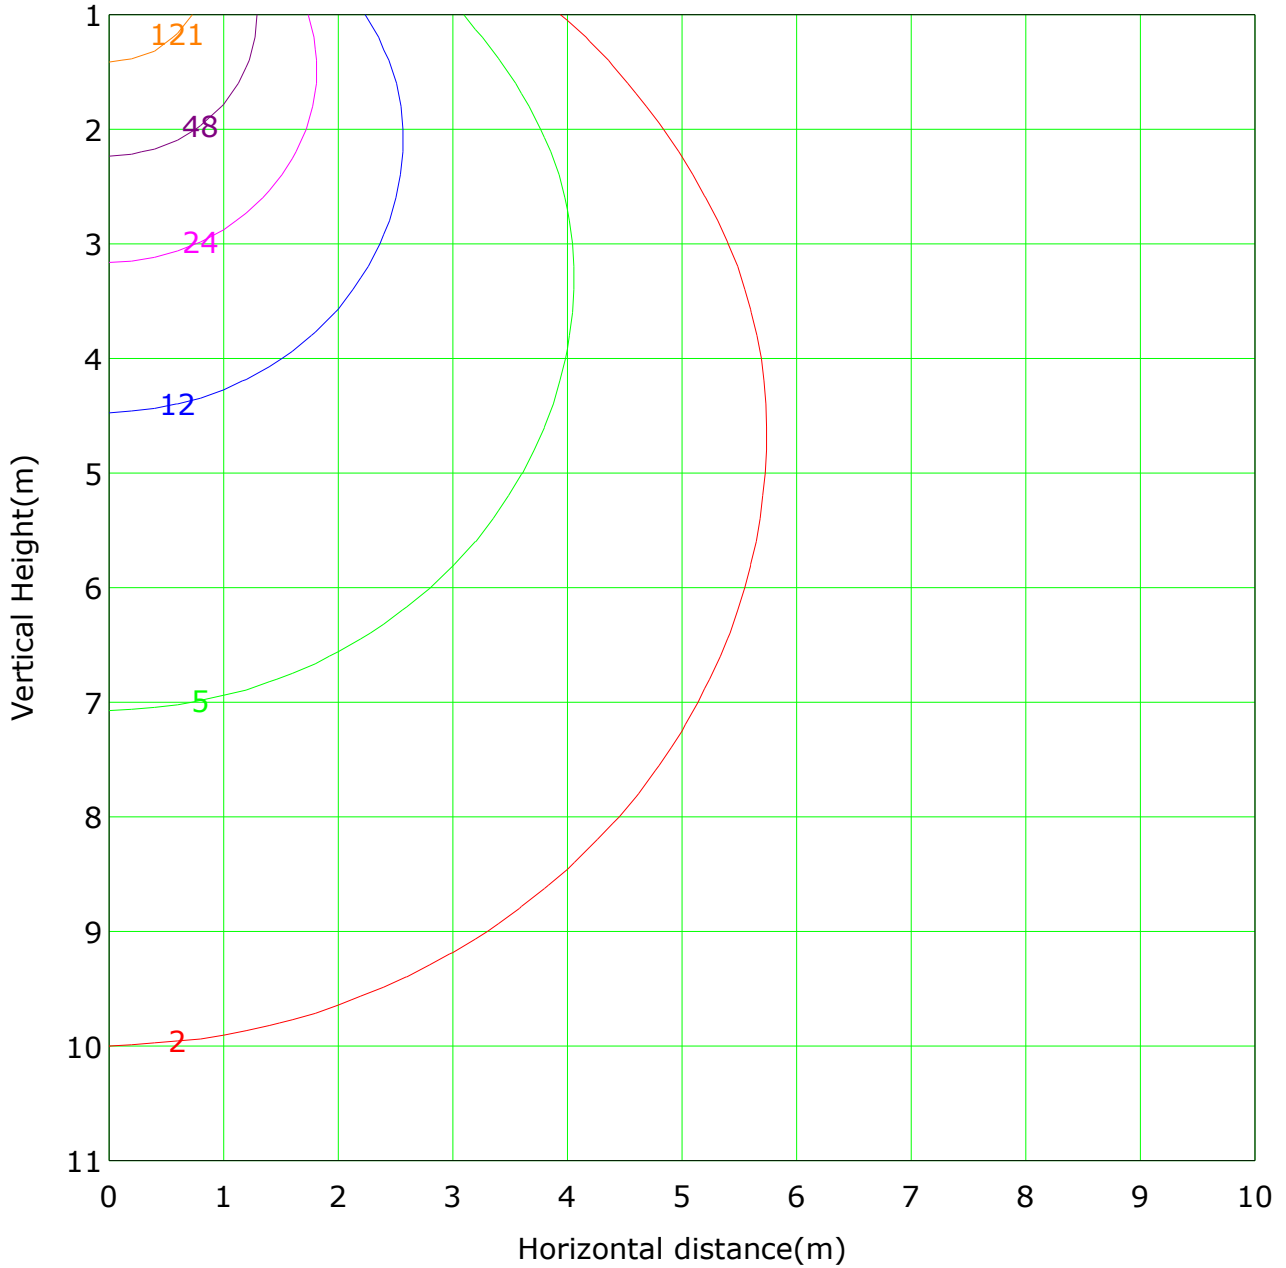


Lowest(m): 1.0m	Highest(m): 11.0m	Max Lux: 242.4 lx
— ( 1%): 2.4 lx	— ( 2%): 4.8 lx	
— ( 5%): 12.1 lx	— ( 10%): 24.2 lx	
— ( 20%): 48.5 lx	— ( 50%): 121.2 lx	

C Plane (°):0.0-360.0: 22.5  
 Test Lab: Bacl  
 Test Type: TYPE C  
 Temperature: 24.8 'C  
 Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0  
 Test Device: GPM-3000  
 Distance: 14.073 m  
 Humidity: 48  
 Inspector:



## The Average Illuminance Effective Figure

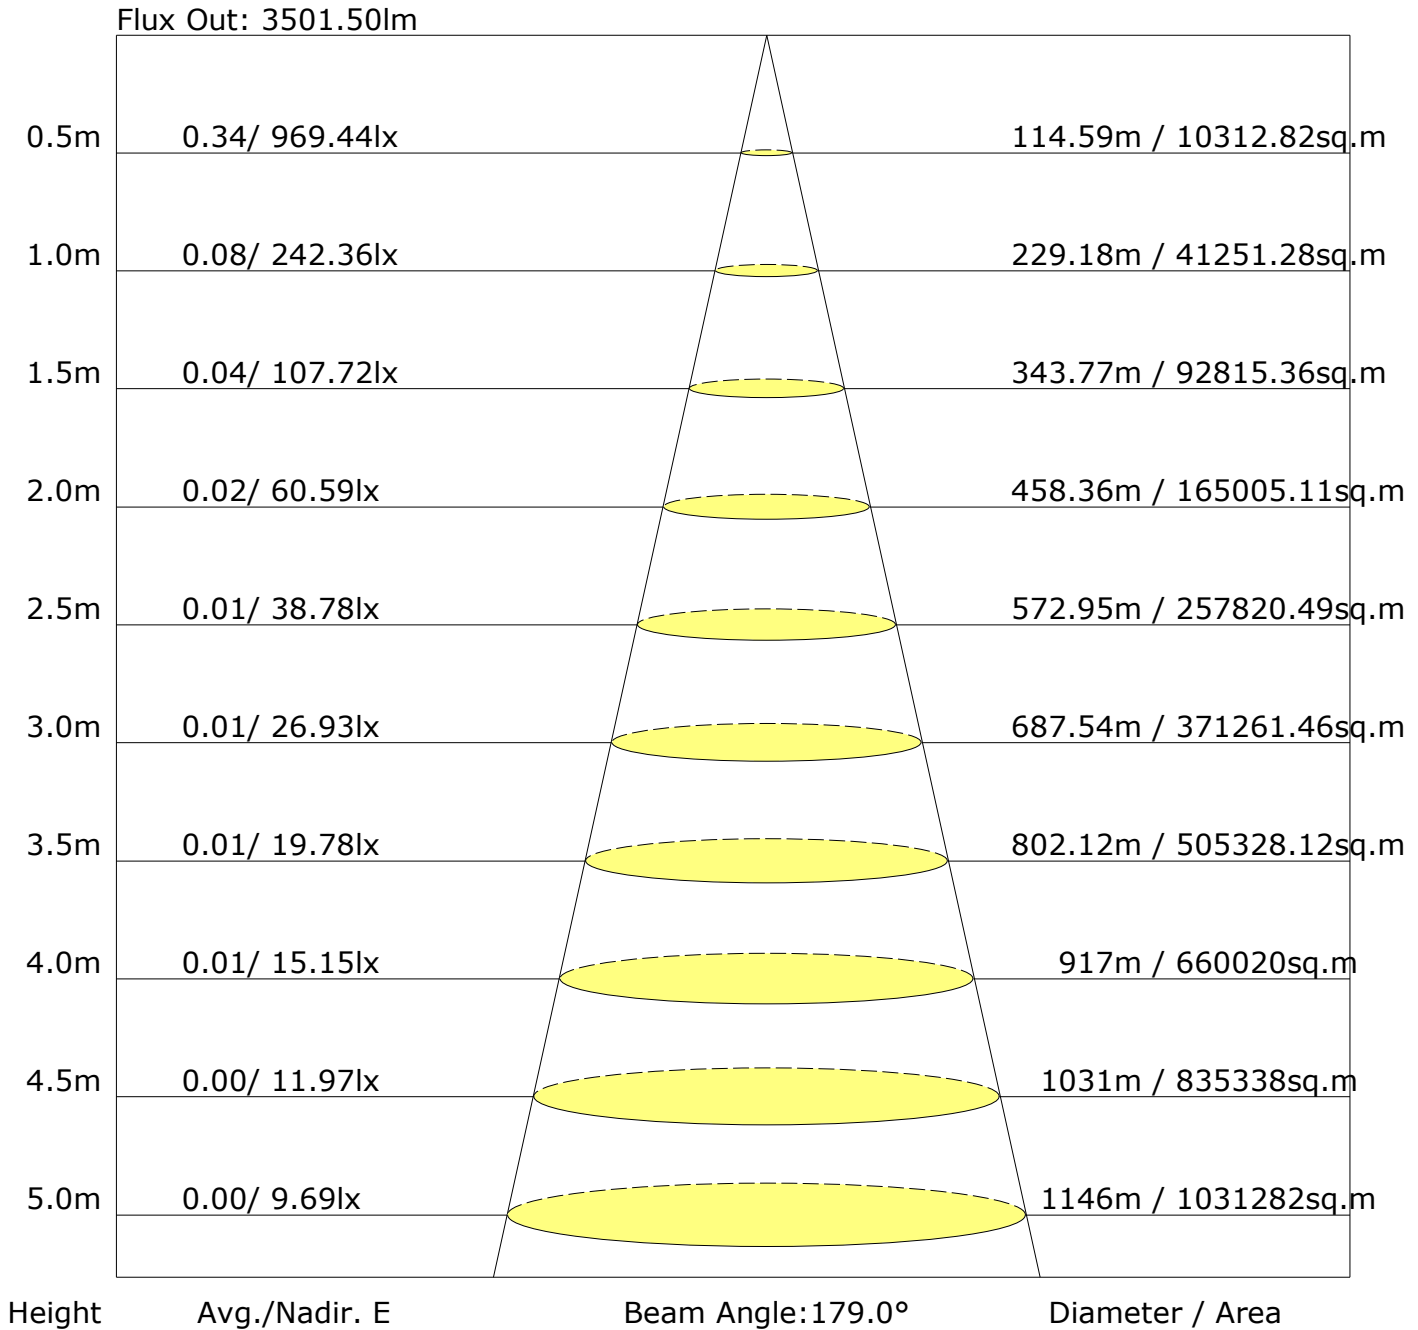

C Plane (°):0.0-360.0: 22.5  
 Test Lab: Bacl  
 Test Type: TYPE C  
 Temperature: 24.8 °C  
 Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0  
 Test Device: GPM-3000  
 Distance: 14.073 m  
 Humidity: 48  
 Inspector:

## UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
3H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
12H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
X=4H Y=2H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
3H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
12H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
X=8H Y=4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
12H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
X=12H Y=4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
Variations with the observer position at spacings:										
S=1.0H										
S=1.5H										
S=2.0H										

Calculate in accordance with CIE Pub.117. The table is revised with 3501lm ( $8\log(F/F_0) = 4.4$ ).

C Plane (°):0.0-360.0: 22.5  
 Test Lab: Bacl  
 Test Type: TYPE C  
 Temperature: 24.8 'C  
 Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0  
 Test Device: GPM-3000  
 Distance: 14.073 m  
 Humidity: 48  
 Inspector:

## Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 2.00									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	NA	0.48	0.53	0.58	0.65	0.70	0.73	0.78	0.81	
	0.30		NA	0.40	0.46	0.50	0.58	0.63	0.67	0.73	0.77	
	0.20		NA	0.34	0.40	0.44	0.52	0.58	0.62	0.68	0.73	
0.50	0.50	0.20	NA	0.40	0.45	0.49	0.54	0.58	0.61	0.65	0.68	
	0.30		NA	0.34	0.39	0.43	0.49	0.53	0.57	0.61	0.64	
	0.20		NA	0.30	0.34	0.38	0.44	0.49	0.52	0.58	0.61	
0.30	0.50	0.20	NA	0.33	0.37	0.40	0.44	0.48	0.50	0.53	0.56	
	0.30		NA	0.28	0.32	0.35	0.40	0.44	0.46	0.50	0.53	
	0.20		NA	0.25	0.28	0.31	0.37	0.41	0.43	0.48	0.50	
0.00	0.00	0.00	NA	0.16	0.19	0.21	0.25	0.28	0.30	0.33	0.35	
<p>Rating:43W Photometrically tested without ceiling board.            Multiply UF values by service correction factors            Calculate in accordance with CIBSE Technical Memorandum NO.5 1980</p>												

## Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 2.00									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	NA	0.84	0.74	0.66	0.55	0.47	0.41	0.33	0.28	
		0.30	NA	0.72	0.65	0.59	0.50	0.43	0.38	0.32	0.27	
		0.20	NA	0.63	0.57	0.53	0.45	0.40	0.36	0.30	0.26	
0.50	0.50	0.20	NA	0.72	0.64	0.57	0.48	0.42	0.36	0.29	0.25	
		0.30	NA	0.62	0.57	0.51	0.44	0.38	0.34	0.28	0.24	
		0.20	NA	0.55	0.51	0.47	0.40	0.35	0.32	0.27	0.23	
0.30	0.50	0.20	NA	0.61	0.55	0.49	0.41	0.35	0.31	0.26	0.22	
		0.30	NA	0.54	0.49	0.45	0.38	0.33	0.30	0.25	0.21	
		0.20	NA	0.48	0.44	0.41	0.35	0.31	0.28	0.23	0.20	
0.00	0.00	0.00	0.50	0.34	0.31	0.29	0.25	0.23	0.20	0.17	0.15	
<p>Rating:43W Photometrically tested without ceiling board.            Multiply UF values by service correction factors            Calculate in accordance with CIBSE Technical Memorandum NO.5 1980</p>												

## Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 2.00								
Room Reflectance			Room Index(RI)								
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00
0.70	0.50	0.20	NA	0.66	0.67	0.67	0.68	0.69	0.69	0.69	0.69
		0.30	NA	0.59	0.60	0.61	0.63	0.64	0.64	0.65	0.66
		0.20	NA	0.54	0.55	0.56	0.58	0.59	0.60	0.62	0.63
0.50	0.50	0.20	NA	0.64	0.64	0.65	0.65	0.66	0.66	0.66	0.66
		0.30	NA	0.58	0.59	0.60	0.61	0.62	0.62	0.63	0.64
		0.20	NA	0.54	0.55	0.56	0.57	0.58	0.59	0.60	0.61
0.30	0.50	0.20	NA	0.61	0.62	0.62	0.63	0.63	0.63	0.64	0.64
		0.30	NA	0.57	0.58	0.58	0.59	0.60	0.60	0.61	0.61
		0.20	NA	0.53	0.54	0.55	0.56	0.57	0.57	0.58	0.59
0.00	0.00	0.00	0.50	0.50	0.50	0.50	0.50	0.50	0.50	0.50	0.50
<p>Rating:43W Photometrically tested without ceiling board.            Multiply UF values by service correction factors            Calculate in accordance with CIBSE Technical Memorandum NO.5 1980</p>											

## Zonal Lumen

Gamma [°]	I <sub>mean</sub> [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-5.0	244.4	5.8	5.8	0.17	0.17
5.0-10.0	245.2	17.5	23.4	0.50	0.67
10.0-15.0	239.3	28.4	51.8	0.81	1.48
15.0-20.0	241.7	39.8	91.6	1.14	2.62
20.0-25.0	258.7	54.3	145.9	1.55	4.17
25.0-30.0	273.7	69.3	215.1	1.98	6.14
30.0-35.0	282.1	83.1	298.2	2.37	8.52
35.0-40.0	288.4	96.2	394.4	2.75	11.27
40.0-45.0	293.2	108.6	503.0	3.10	14.37
45.0-50.0	295.3	119.3	622.3	3.41	17.77
50.0-55.0	294.8	128.2	750.5	3.66	21.43
55.0-60.0	291.8	134.9	885.4	3.85	25.29
60.0-65.0	287.3	139.7	1025.1	3.99	29.28
65.0-70.0	282.6	143.1	1168.2	4.09	33.36
70.0-75.0	279.5	146.1	1314.3	4.17	37.54
75.0-80.0	277.3	148.4	1462.7	4.24	41.77
80.0-85.0	272.8	148.2	1610.9	4.23	46.01
85.0-90.0	265.1	145.2	1756.1	4.15	50.15
90.0-95.0	259.4	142.1	1898.2	4.06	54.21
95.0-100.0	257.9	140.2	2038.3	4.00	58.21
100.0-105.0	261.0	139.7	2178.0	3.99	62.20
105.0-110.0	269.9	141.1	2319.1	4.03	66.23
110.0-115.0	280.8	142.2	2461.3	4.06	70.29
115.0-120.0	290.5	141.2	2602.5	4.03	74.33
120.0-125.0	298.1	137.8	2740.3	3.94	78.26
125.0-130.0	303.1	131.8	2872.1	3.76	82.03
130.0-135.0	304.6	123.1	2995.2	3.52	85.54
135.0-140.0	303.2	112.3	3107.5	3.21	88.75
140.0-145.0	298.4	99.6	3207.1	2.84	91.59
145.0-150.0	289.8	85.4	3292.4	2.44	94.03
150.0-155.0	277.5	70.2	3362.7	2.01	96.04
155.0-160.0	257.8	54.1	3416.7	1.54	97.58
160.0-165.0	233.1	38.4	3455.2	1.10	98.68
165.0-170.0	219.2	26.0	3481.2	0.74	99.42
170.0-175.0	214.2	15.3	3496.5	0.44	99.86
175.0-180.0	209.4	5.0	3501.5	0.14	100.00

C Plane (°):0.0-360.0: 22.5  
 Test Lab: Bacl  
 Test Type: TYPE C  
 Temperature: 24.8 'C  
 Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0  
 Test Device: GPM-3000  
 Distance: 14.073 m  
 Humidity: 48  
 Inspector:

## Candlepower Table

Unit: cd

G\C	C0.0	C22.5	C45.0	C67.5	C90.0	C112.5	C135.0	C157.5	C180.0	C202.5
G0.0	242.4	242.4	242.4	242.4	242.4	242.4	242.4	242.4	242.4	242.4
G5.0	240.8	246.0	260.0	270.7	276.7	275.0	265.9	253.1	241.6	238.1
G10.0	237.2	255.3	289.6	313.9	327.1	321.8	301.9	272.3	239.4	230.3
G15.0	231.1	264.8	317.5	356.5	375.7	367.0	336.7	289.9	235.9	217.5
G20.0	223.2	272.7	344.3	395.9	424.5	412.4	368.3	305.5	230.8	197.8
G25.0	212.9	277.8	368.5	435.5	469.7	454.0	399.4	317.9	224.1	170.0
G30.0	201.1	281.0	389.6	471.1	513.4	494.1	427.3	328.7	215.4	132.4
G35.0	186.9	282.1	409.5	505.2	554.6	531.5	452.6	336.5	205.2	93.4
G40.0	171.4	280.6	425.1	535.5	590.9	565.3	474.4	341.8	193.3	83.9
G45.0	154.2	277.5	438.4	561.5	623.9	595.6	493.3	344.6	179.7	92.8
G50.0	135.9	272.3	448.1	583.7	651.5	620.5	508.5	344.5	164.9	112.1
G55.0	116.9	265.3	454.1	601.4	675.2	642.0	519.7	343.1	149.1	109.0
G60.0	96.7	255.9	455.7	614.7	692.5	657.0	527.5	338.0	132.2	94.1
G65.0	75.9	244.4	454.5	623.4	705.2	666.5	530.4	331.0	114.5	79.6
G70.0	57.4	231.5	449.4	626.2	712.2	671.3	530.3	321.3	95.9	65.8
G75.0	42.2	217.1	443.0	623.4	714.2	671.1	525.0	309.0	77.4	52.8
G80.0	27.4	200.8	432.6	615.9	709.6	664.7	515.8	293.9	59.0	46.9
G85.0	13.9	183.7	419.8	604.9	700.4	653.1	502.5	277.4	41.3	46.7
G90.0	5.3	172.8	411.1	598.8	695.2	647.2	495.6	269.1	33.1	32.8
G95.0	12.1	184.7	423.7	610.0	705.6	658.1	507.0	282.9	46.5	26.7
G100.0	27.1	203.9	440.1	624.6	715.5	670.3	521.7	301.8	66.4	37.2
G105.0	44.4	222.5	454.8	634.3	722.1	677.8	532.9	317.7	87.1	52.3
G110.0	62.3	239.4	464.9	640.4	723.3	681.6	539.6	332.1	107.8	69.0
G115.0	81.2	254.4	471.2	640.2	717.3	678.0	542.7	343.1	127.8	86.0
G120.0	101.4	267.8	474.2	634.4	707.8	669.9	540.5	352.2	146.9	100.1
G125.0	116.8	279.7	472.9	623.0	690.6	654.6	535.3	357.3	164.5	115.9
G130.0	126.7	289.2	468.4	607.0	669.5	636.7	525.4	359.9	179.9	115.7
G135.0	133.7	296.4	460.4	586.6	642.8	611.6	511.8	359.5	192.5	91.1
G140.0	139.6	301.8	449.7	561.1	612.0	584.0	494.0	351.6	202.7	80.1
G145.0	143.6	304.4	435.1	532.1	576.5	552.2	471.5	328.6	210.3	88.0
G150.0	146.5	305.0	417.1	500.1	536.2	514.7	438.0	306.3	214.5	113.7
G155.0	155.8	302.2	397.0	464.5	494.6	474.5	386.2	294.8	217.8	141.8
G160.0	166.3	295.8	373.8	425.7	449.3	429.8	335.0	265.1	218.1	153.4
G165.0	180.9	266.0	347.4	385.7	402.9	373.4	286.1	243.0	208.2	167.0
G170.0	204.4	253.2	287.8	341.7	353.8	290.7	250.0	224.4	209.7	184.6
G175.0	226.0	241.3	255.0	244.7	295.4	194.4	224.2	226.8	218.9	213.8
G180.0	233.8	237.5	237.3	224.2	91.9	192.1	221.2	228.2	233.6	237.4

C Plane (°):0.0-360.0: 22.5  
 Test Lab: Bacl  
 Test Type: TYPE C  
 Temperature: 24.8 'C  
 Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0  
 Test Device: GPM-3000  
 Distance: 14.073 m  
 Humidity: 48  
 Inspector:

## Candlepower Table (Continue 1)

Unit: cd

G\C	C225.0	C247.5	C270.0	C292.5	C315.0	C337.5	C360.0			
G0.0	242.4	242.4	242.4	242.4	242.4	242.4	242.4			
G5.0	232.7	226.1	224.2	224.8	230.3	235.8	240.8			
G10.0	207.1	173.7	154.2	163.0	195.1	223.3	237.2			
G15.0	153.3	93.5	103.1	96.1	116.4	198.2	231.1			
G20.0	88.9	133.8	176.3	155.6	95.1	156.4	223.2			
G25.0	108.5	199.9	209.7	203.7	145.7	98.0	212.9			
G30.0	159.3	192.1	202.3	195.7	182.2	75.7	201.1			
G35.0	169.5	184.4	196.6	188.8	172.9	95.1	186.9			
G40.0	158.2	177.3	188.7	181.1	163.4	133.6	171.4			
G45.0	147.0	167.5	178.8	170.8	154.7	136.6	154.2			
G50.0	136.3	157.0	168.8	160.2	143.3	123.8	135.9			
G55.0	123.4	146.9	160.5	151.1	132.0	111.1	116.9			
G60.0	110.5	139.9	155.8	145.1	121.1	98.9	96.7			
G65.0	100.0	135.5	153.8	141.8	115.8	85.0	75.9			
G70.0	94.8	138.6	161.4	145.7	113.7	72.0	57.4			
G75.0	96.1	152.0	181.1	164.8	119.4	67.3	42.2			
G80.0	104.1	167.0	200.3	177.9	130.8	69.6	27.4			
G85.0	108.0	171.9	202.7	181.0	135.3	69.4	13.9			
G90.0	97.7	161.8	191.5	172.7	127.2	58.6	5.3			
G95.0	71.2	138.0	165.1	147.9	108.3	44.0	12.1			
G100.0	57.0	100.2	128.2	112.7	75.0	40.8	27.1			
G105.0	66.3	88.6	105.5	94.4	74.3	54.1	44.4			
G110.0	80.4	100.5	108.1	100.3	89.2	68.0	62.3			
G115.0	95.2	113.8	124.1	115.7	102.0	85.0	81.2			
G120.0	110.6	128.3	137.5	129.1	116.1	100.8	101.4			
G125.0	125.8	142.3	152.5	143.3	130.6	116.8	116.8			
G130.0	141.1	157.0	165.9	157.5	145.7	130.2	126.7			
G135.0	156.1	170.9	180.8	172.3	159.6	144.0	133.7			
G140.0	165.5	184.1	193.9	185.4	172.6	155.7	139.6			
G145.0	168.6	196.3	206.1	197.8	183.1	121.4	143.6			
G150.0	160.3	199.2	216.6	207.2	192.5	90.4	146.5			
G155.0	102.8	191.7	222.5	214.8	176.7	85.3	155.8			
G160.0	73.6	118.3	200.6	179.4	107.2	134.3	166.3			
G165.0	124.4	74.7	104.5	103.0	104.1	161.5	180.9			
G170.0	168.6	128.0	97.5	150.6	155.7	181.9	204.4			
G175.0	203.7	175.8	105.1	150.7	188.5	206.3	226.0			
G180.0	236.6	224.0	91.8	192.2	221.4	227.3	233.8			

C Plane (°):0.0-360.0: 22.5  
 Test Lab: Bacl  
 Test Type: TYPE C  
 Temperature: 24.8 'C  
 Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0  
 Test Device: GPM-3000  
 Distance: 14.073 m  
 Humidity: 48  
 Inspector: