
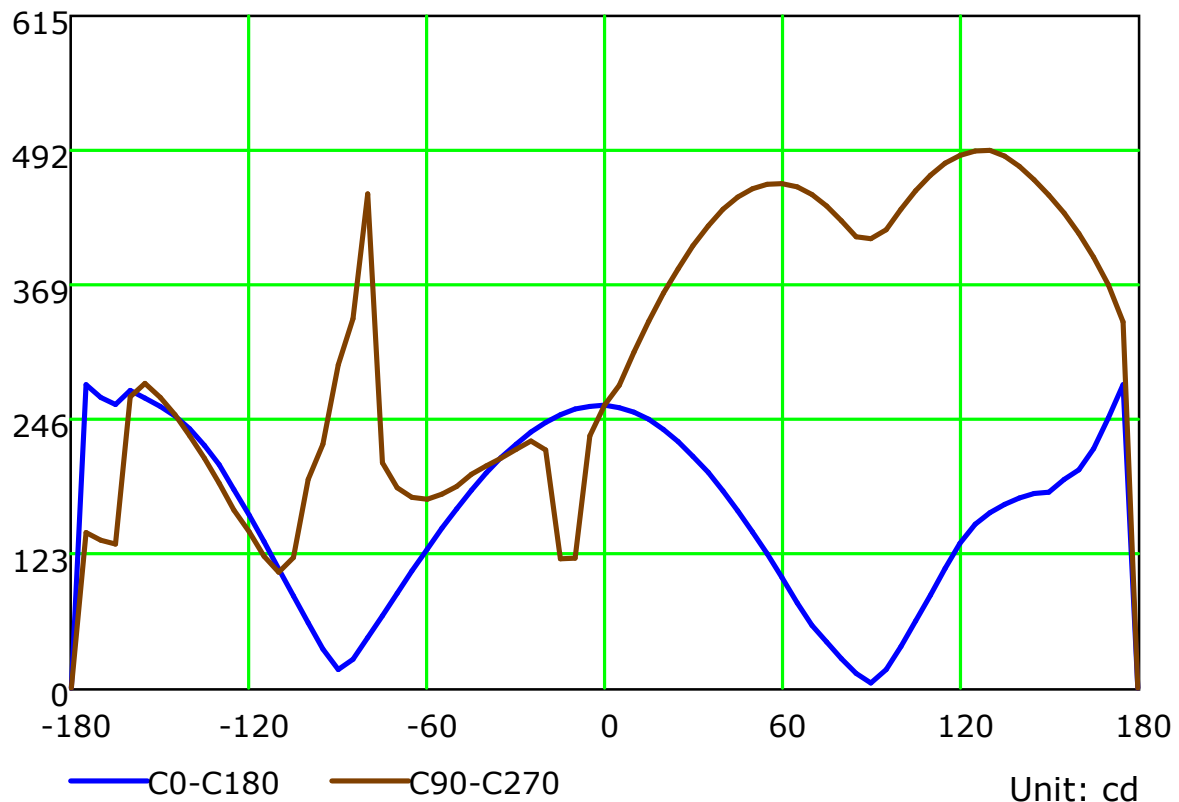



Luminous Intensity Distribution Curve

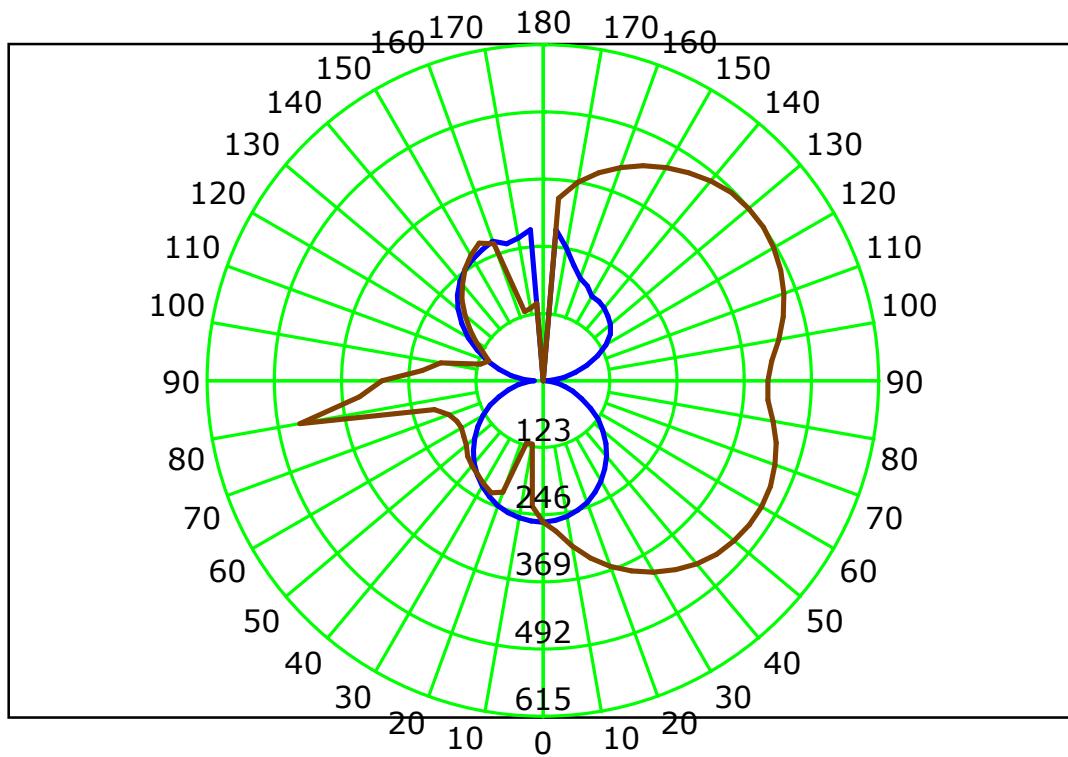

C Plane (°):0.0-360.0: 22.5
Test Lab: Bacl
Test Type: TYPE C
Temperature: 25.3 'C
Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0
Test Device: GPM-3000
Distance: 14.073 m
Humidity: 48
Inspector:

Luminous Intensity Distribution Curve(cd/klm)

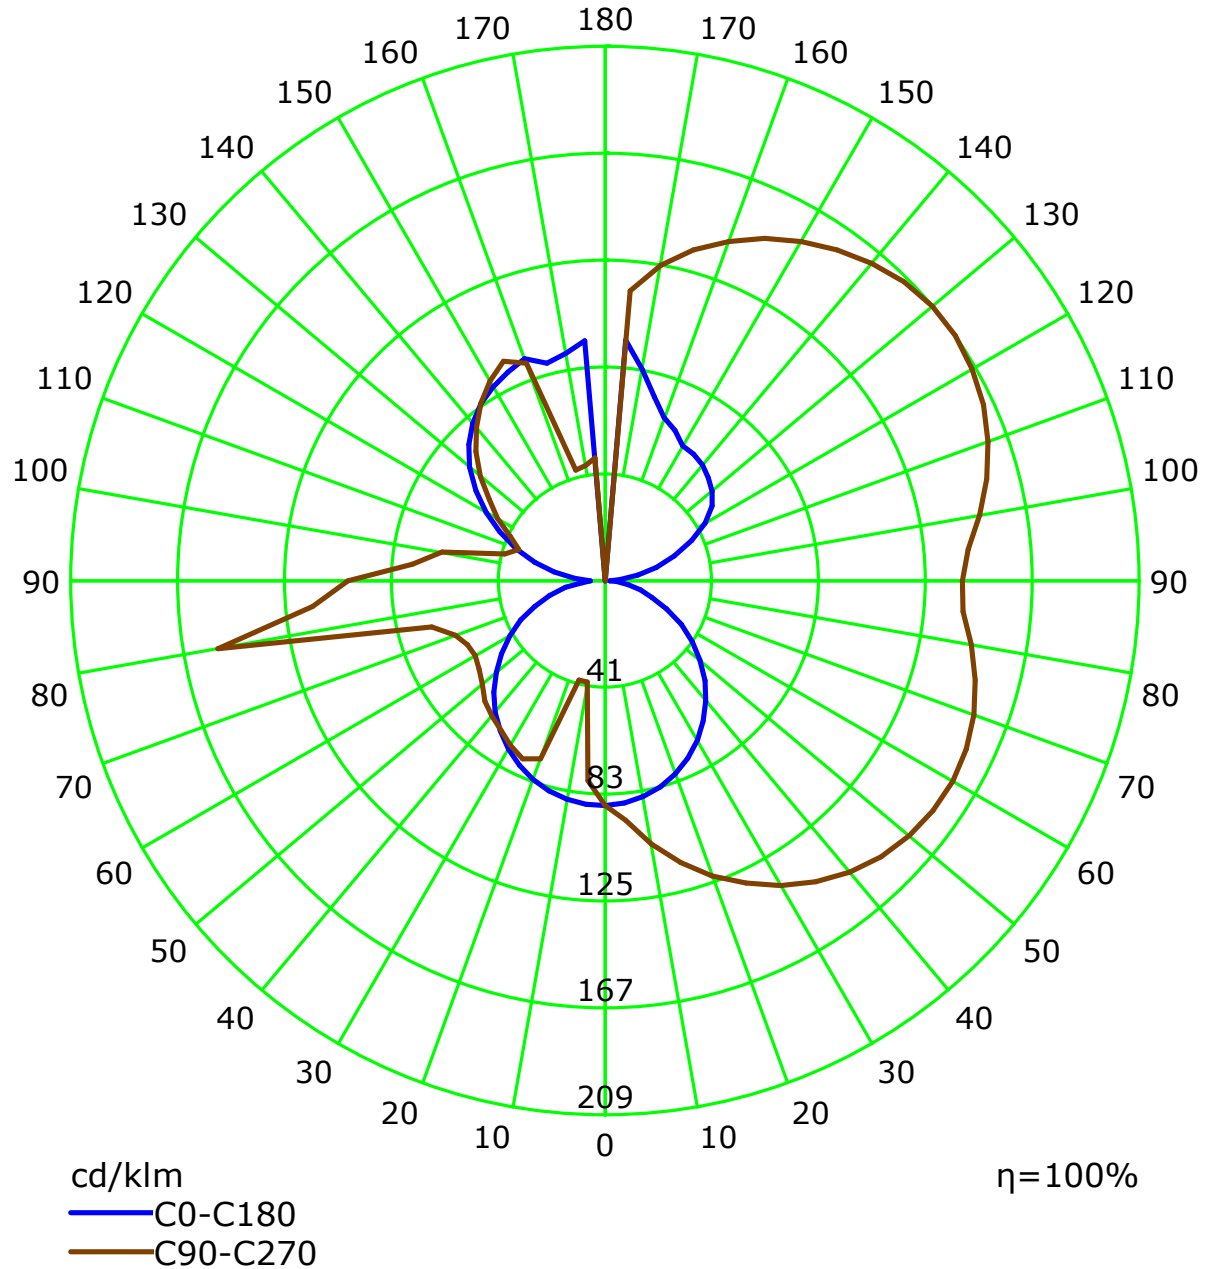

C Plane (°):0.0-360.0: 22.5
Test Lab: Bacl
Test Type: TYPE C
Temperature: 25.3 'C
Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0
Test Device: GPM-3000
Distance: 14.073 m
Humidity: 48
Inspector:


Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	1.07	1.07	1.07	1.07	.99	.99	.99	.99	.83	.83	.83	.69	.69	.69	.56	.56	.56	.50
1	.94	.88	.82	.78	.86	.81	.76	.72	.67	.63	.60	.55	.52	.49	.43	.41	.39	.34
2	.84	.75	.67	.61	.77	.68	.62	.56	.57	.52	.47	.46	.42	.39	.36	.33	.30	.25
3	.76	.65	.56	.49	.69	.59	.51	.45	.49	.43	.38	.39	.35	.31	.31	.27	.24	.20
4	.69	.56	.47	.40	.63	.52	.44	.37	.43	.36	.31	.35	.30	.26	.27	.23	.20	.16
5	.63	.50	.41	.34	.57	.46	.38	.31	.38	.31	.27	.31	.26	.22	.24	.20	.17	.14
6	.58	.44	.35	.29	.52	.41	.33	.27	.34	.27	.23	.27	.22	.19	.21	.18	.15	.11
7	.53	.40	.31	.25	.48	.37	.29	.23	.30	.24	.20	.25	.20	.16	.19	.16	.13	.10
8	.49	.36	.27	.22	.45	.33	.25	.20	.28	.21	.17	.23	.18	.14	.18	.14	.11	.09
9	.46	.33	.25	.19	.42	.30	.23	.18	.25	.19	.15	.21	.16	.12	.16	.13	.10	.08
10	.43	.30	.22	.17	.39	.27	.20	.16	.23	.17	.13	.19	.14	.11	.15	.11	.09	.07

Spacing Criteria (0-180): 1.25

Spacing Criteria (90-270): 1.83


Spacing Criteria (Diagonal): 1.71

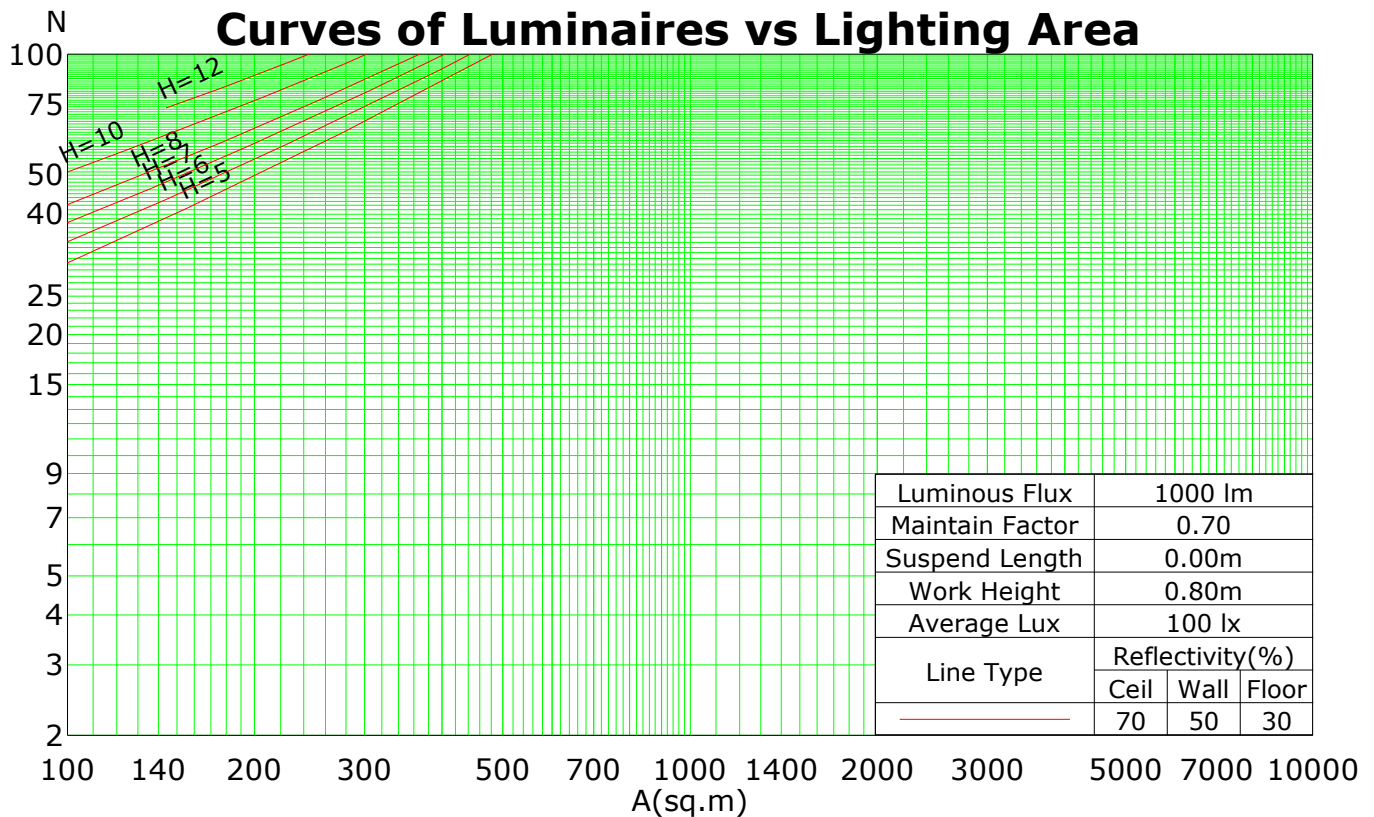

C Plane (°):0.0-360.0: 22.5
Test Lab: Bacl
Test Type: TYPE C
Temperature: 25.3 'C
Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0
Test Device: GPM-3000
Distance: 14.073 m
Humidity: 48
Inspector:

IsoLux Plot

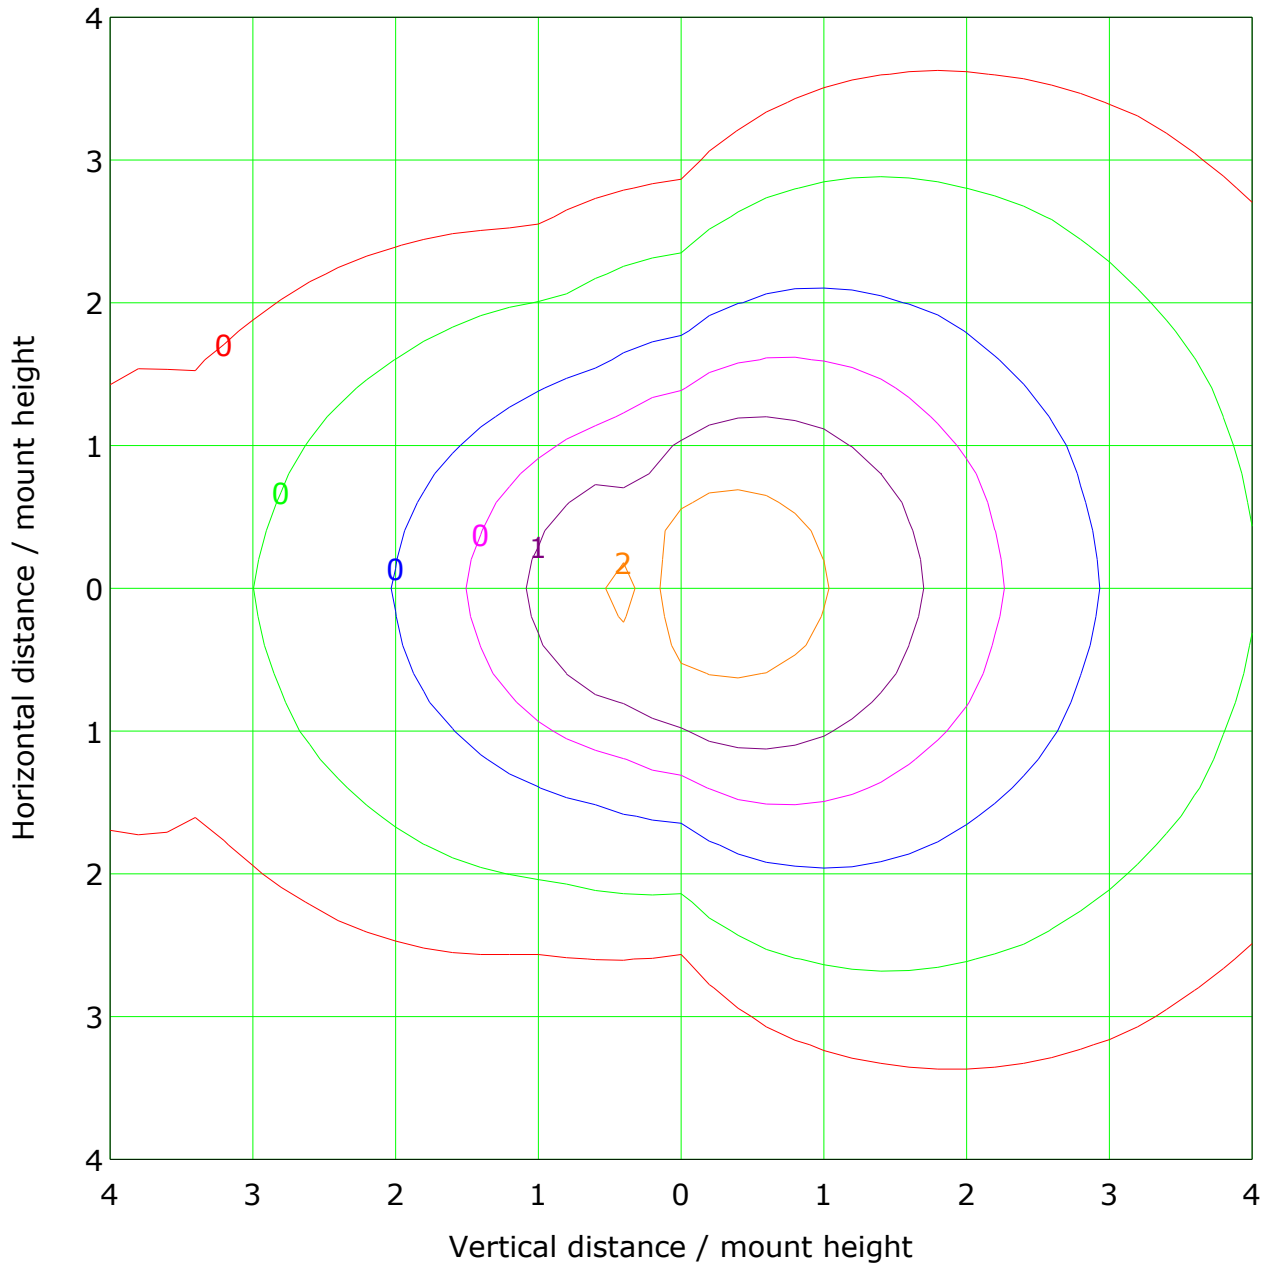

Mounting Height: 10.0m Max Lux(100%): 3.0 lx

(1%): 0.0 lx	(2%): 0.1 lx
(5%): 0.2 lx	(10%): 0.3 lx
(20%): 0.6 lx	(50%): 1.5 lx



C Plane (°):0.0-360.0: 22.5
Test Lab: Bacl
Test Type: TYPE C
Temperature: 25.3 'C
Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0
Test Device: GPM-3000
Distance: 14.073 m
Humidity: 48
Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

a b c d e f g h

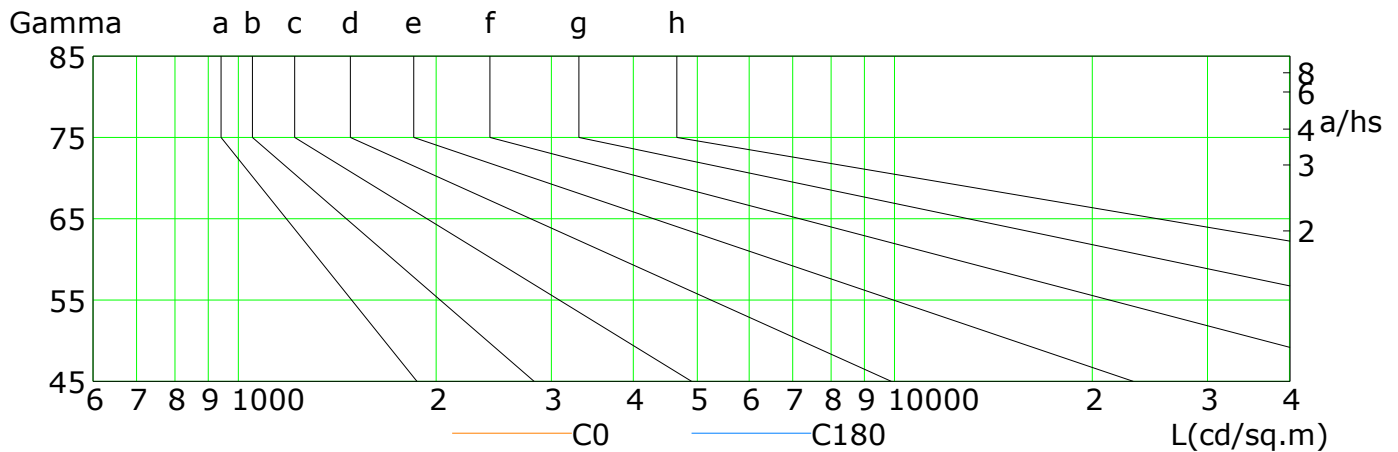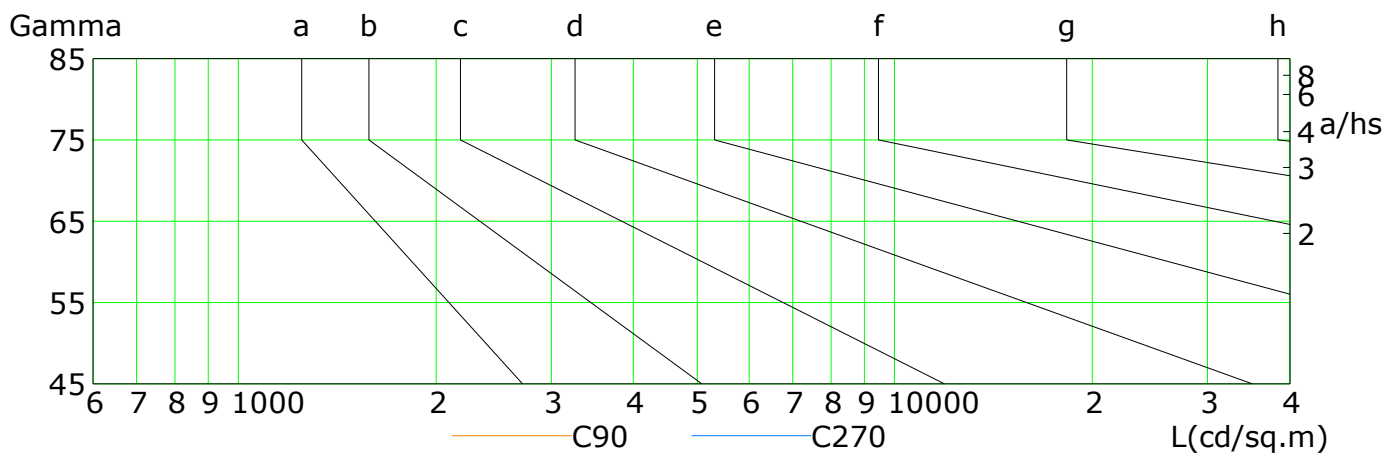


L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	163	143	123	101	78	58	42	27	13
C90	450	457	461	462	459	452	442	428	413
C180	182	164	147	127	108	87	67	47	27
C270	196	185	178	173	175	184	207	453	339

C Plane (°):0.0-360.0: 22.5
Test Lab: Bacl
Test Type: TYPE C
Temperature: 25.3 'C
Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0
Test Device: GPM-3000
Distance: 14.073 m
Humidity: 48
Inspector:


Illuminance at a Distance

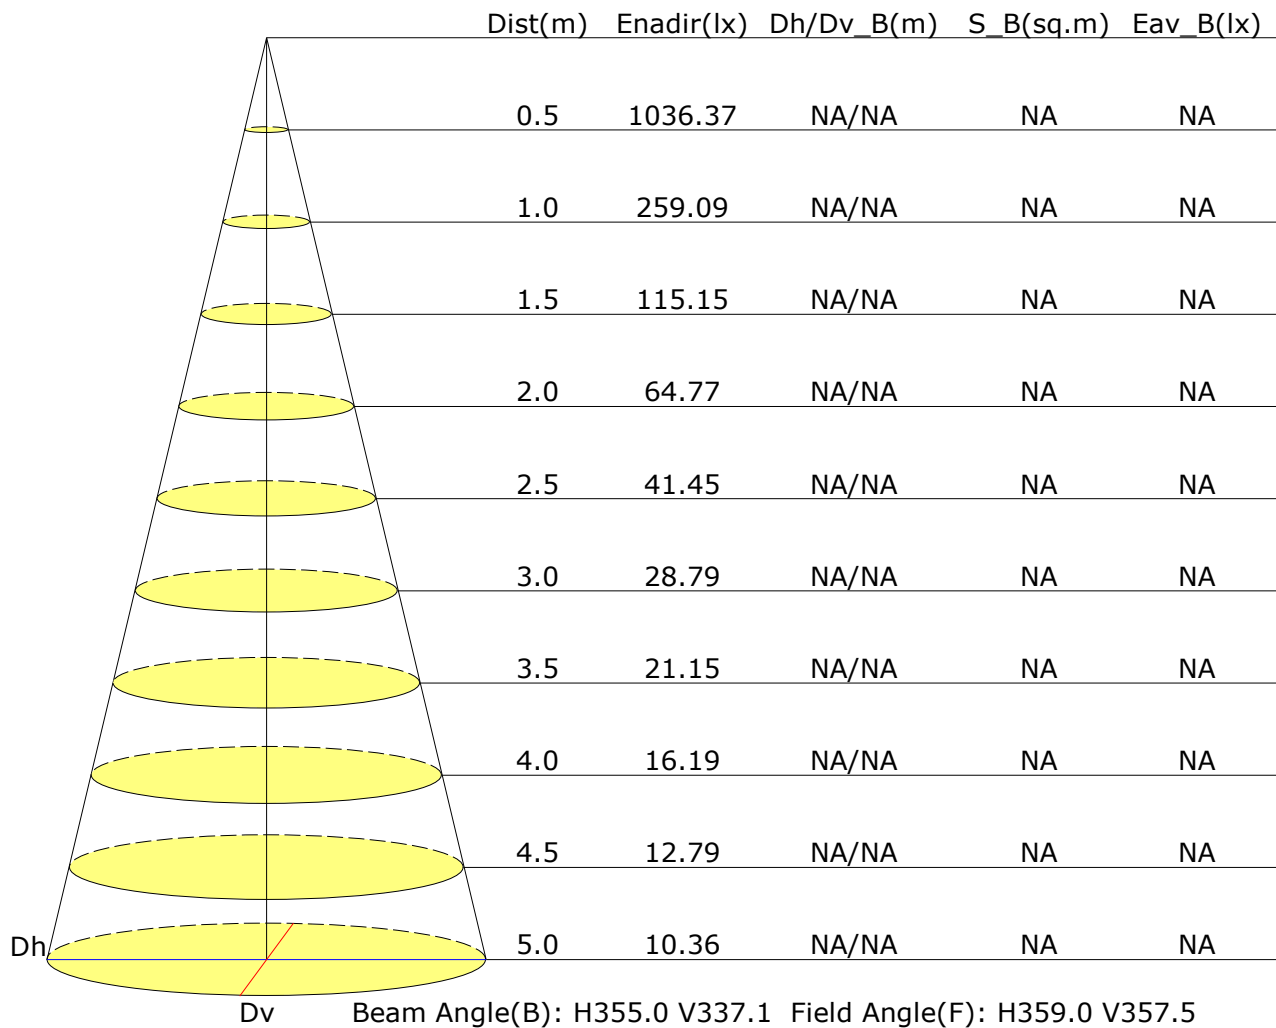

C Plane (°):0.0-360.0: 22.5
Test Lab: Bacl
Test Type: TYPE C
Temperature: 25.3 'C
Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0
Test Device: GPM-3000
Distance: 14.073 m
Humidity: 48
Inspector:

Vertical IsoLux Plot

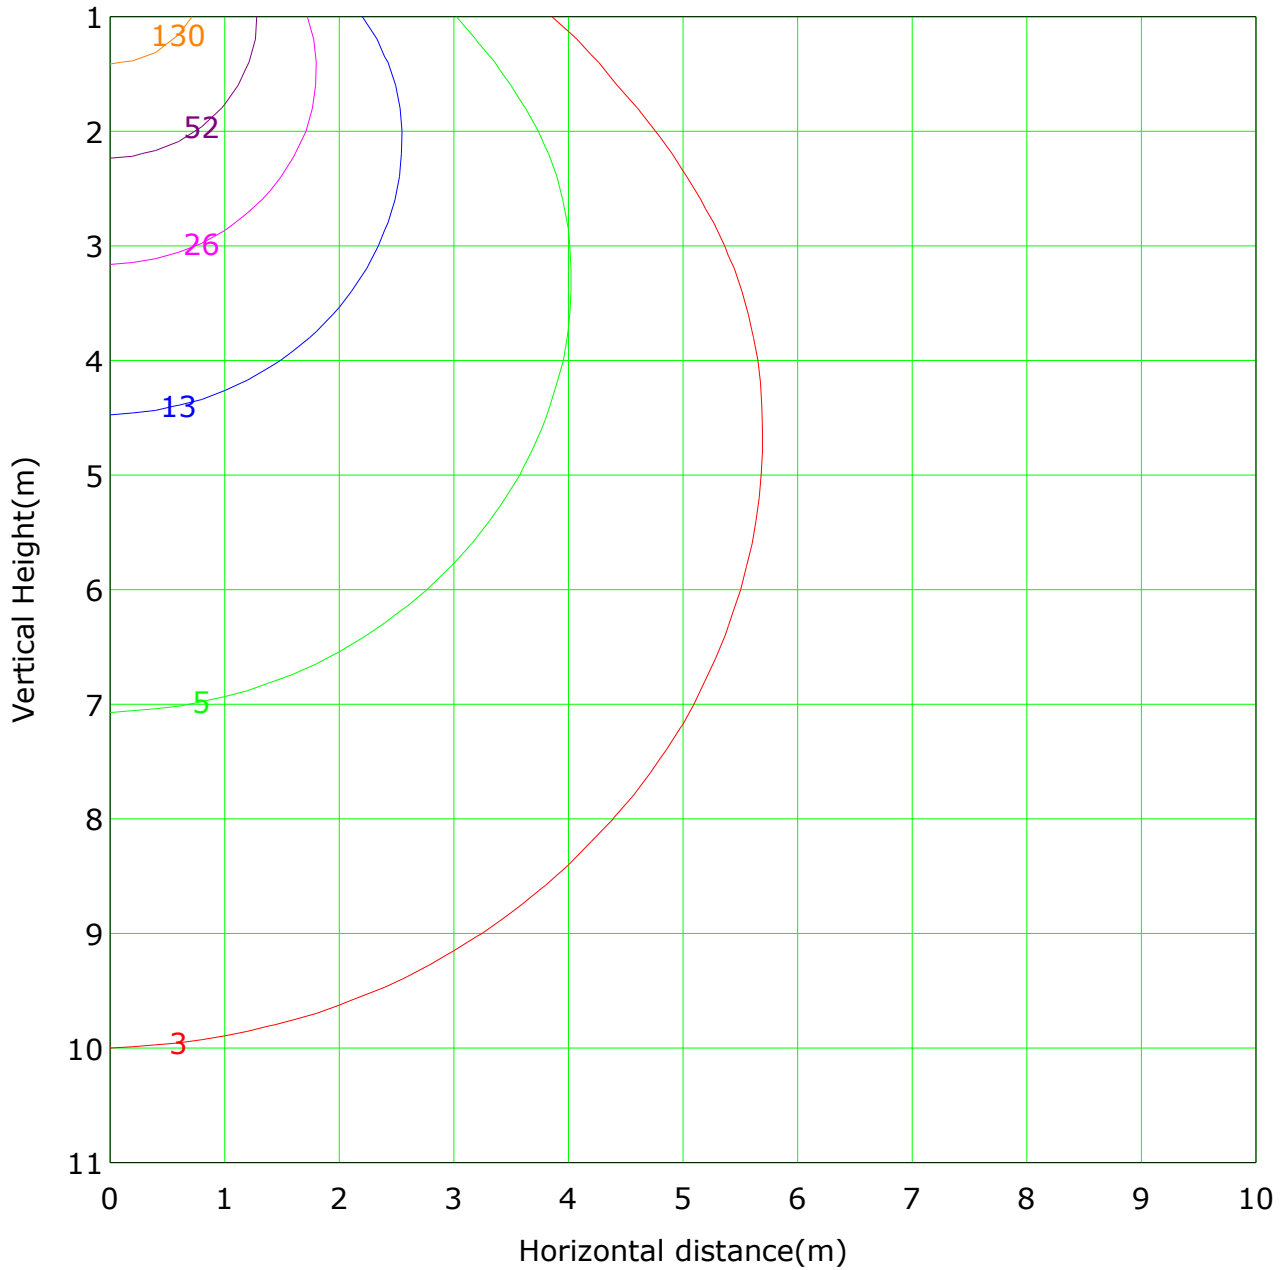


Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 259.1 lx
— (1%): 2.6 lx — (2%): 5.2 lx
— (5%): 13.0 lx — (10%): 25.9 lx
— (20%): 51.8 lx — (50%): 129.5 lx

C Plane (°):0.0-360.0: 22.5
Test Lab: Bacl
Test Type: TYPE C
Temperature: 25.3 'C
Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0
Test Device: GPM-3000
Distance: 14.073 m
Humidity: 48
Inspector:

The Average Illuminance Effective Figure

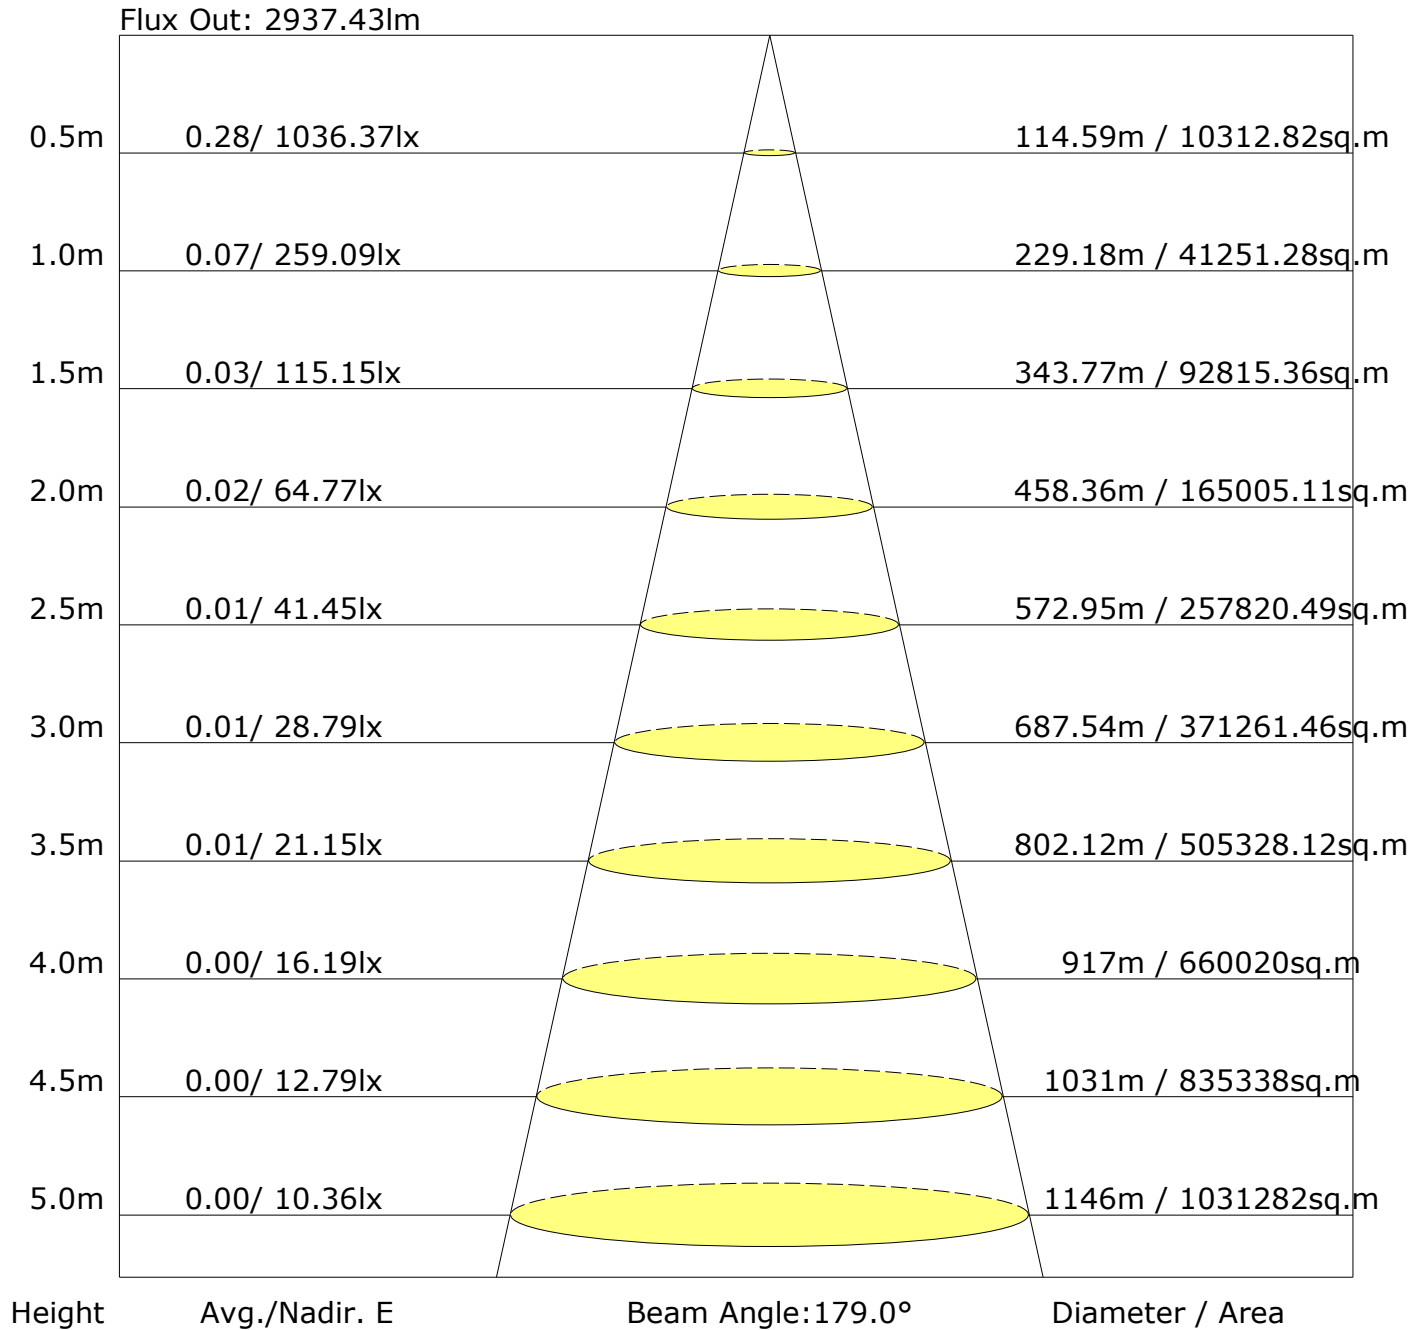

UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
3H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
12H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
X=4H Y=2H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
3H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
12H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
X=8H Y=4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
12H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
X=12H Y=4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
Variations with the observer position at spacings:										
S=1.0H	-1.\$/-1.\$					-1.\$/-1.\$				
S=1.5H	-1.\$/-1.\$					-1.\$/-1.\$				
S=2.0H	-1.\$/-1.\$					-1.\$/-1.\$				

Calculate in accordance with CIE Pub.117. The table is revised with 2937lm ($8\log(F/F_0) = 3.7$).

C Plane (°):0.0-360.0: 22.5
Test Lab: Bacl
Test Type: TYPE C
Temperature: 25.3 'C
Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0
Test Device: GPM-3000
Distance: 14.073 m
Humidity: 48
Inspector:

Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 1.75									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	NA	0.48	0.54	0.59	0.65	0.70	0.73	0.78	0.81	
	0.30		NA	0.40	0.46	0.51	0.58	0.63	0.67	0.73	0.76	
	0.20		NA	0.34	0.40	0.45	0.53	0.58	0.62	0.68	0.72	
0.50	0.50	0.20	NA	0.40	0.45	0.49	0.54	0.58	0.61	0.65	0.67	
	0.30		NA	0.34	0.39	0.43	0.49	0.53	0.56	0.61	0.64	
	0.20		NA	0.30	0.34	0.38	0.45	0.49	0.53	0.58	0.61	
0.30	0.50	0.20	NA	0.33	0.37	0.40	0.44	0.47	0.50	0.53	0.55	
	0.30		NA	0.28	0.32	0.36	0.40	0.44	0.46	0.50	0.53	
	0.20		NA	0.24	0.29	0.32	0.37	0.41	0.43	0.47	0.50	
0.00	0.00	0.00	NA	0.16	0.19	0.21	0.25	0.28	0.30	0.32	0.35	
Rating:77W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 1.75									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	NA	0.83	0.73	0.65	0.54	0.46	0.41	0.33	0.28	
	0.30		NA	0.71	0.63	0.57	0.49	0.42	0.38	0.31	0.26	
	0.20		NA	0.62	0.56	0.52	0.44	0.39	0.35	0.29	0.25	
0.50	0.50	0.20	NA	0.71	0.62	0.56	0.46	0.41	0.35	0.29	0.24	
	0.30		NA	0.62	0.55	0.50	0.42	0.37	0.33	0.27	0.23	
	0.20		NA	0.54	0.49	0.45	0.39	0.34	0.31	0.26	0.22	
0.30	0.50	0.20	NA	0.60	0.53	0.47	0.40	0.34	0.30	0.25	0.21	
	0.30		NA	0.53	0.47	0.43	0.37	0.32	0.29	0.24	0.21	
	0.20		NA	0.47	0.43	0.39	0.34	0.30	0.27	0.23	0.20	
0.00	0.00	0.00	0.49	0.33	0.30	0.28	0.24	0.22	0.20	0.17	0.15	
Rating:77W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 1.75									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	NA	0.67	0.67	0.68	0.69	0.69	0.69	0.70	0.70	
	0.30		NA	0.60	0.61	0.62	0.63	0.64	0.65	0.66	0.67	
	0.20		NA	0.55	0.56	0.57	0.59	0.60	0.61	0.62	0.64	
0.50	0.50	0.20	NA	0.64	0.65	0.65	0.66	0.66	0.66	0.67	0.67	
	0.30		NA	0.59	0.60	0.60	0.61	0.62	0.63	0.64	0.64	
	0.20		NA	0.54	0.55	0.56	0.58	0.59	0.59	0.61	0.61	
0.30	0.50	0.20	NA	0.62	0.62	0.63	0.63	0.64	0.64	0.64	0.64	
	0.30		NA	0.57	0.58	0.59	0.60	0.60	0.61	0.61	0.62	
	0.20		NA	0.54	0.55	0.55	0.56	0.57	0.58	0.59	0.60	
0.00	0.00	0.00	0.50	0.50	0.50	0.50	0.50	0.50	0.50	0.50	0.50	
Rating:77W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Zonal Lumen

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-5.0	257.5	6.2	6.2	0.21	0.21
5.0-10.0	246.8	17.7	23.8	0.60	0.81
10.0-15.0	231.9	27.5	51.3	0.94	1.75
15.0-20.0	233.8	38.5	89.9	1.31	3.06
20.0-25.0	246.3	51.7	141.5	1.76	4.82
25.0-30.0	252.4	63.9	205.4	2.18	6.99
30.0-35.0	253.7	74.7	280.1	2.54	9.54
35.0-40.0	253.8	84.7	364.9	2.88	12.42
40.0-45.0	252.5	93.5	458.4	3.18	15.61
45.0-50.0	248.0	100.2	558.6	3.41	19.02
50.0-55.0	240.5	104.6	663.2	3.56	22.58
55.0-60.0	231.4	107.0	770.1	3.64	26.22
60.0-65.0	222.0	107.9	878.1	3.67	29.90
65.0-70.0	213.3	108.0	986.1	3.68	33.57
70.0-75.0	207.0	108.2	1094.3	3.68	37.26
75.0-80.0	222.3	119.0	1213.3	4.05	41.31
80.0-85.0	230.6	125.3	1338.6	4.27	45.58
85.0-90.0	210.8	115.4	1454.0	3.93	49.51
90.0-95.0	194.7	106.6	1560.6	3.63	53.14
95.0-100.0	188.1	102.2	1662.8	3.48	56.62
100.0-105.0	189.0	101.1	1764.0	3.44	60.06
105.0-110.0	197.2	103.1	1867.0	3.51	63.57
110.0-115.0	212.7	107.7	1974.8	3.67	67.24
115.0-120.0	231.0	112.3	2087.1	3.82	71.06
120.0-125.0	248.2	114.7	2201.8	3.91	74.97
125.0-130.0	263.7	114.7	2316.5	3.90	78.87
130.0-135.0	275.4	111.3	2427.8	3.79	82.66
135.0-140.0	283.7	105.1	2532.8	3.58	86.24
140.0-145.0	288.1	96.1	2629.0	3.27	89.51
145.0-150.0	288.8	85.1	2714.0	2.90	92.41
150.0-155.0	286.0	72.4	2786.4	2.46	94.87
155.0-160.0	274.4	57.6	2844.0	1.96	96.83
160.0-165.0	255.3	42.1	2886.1	1.43	98.26
165.0-170.0	249.6	29.6	2915.7	1.01	99.27
170.0-175.0	255.8	18.3	2934.0	0.62	99.90
175.0-180.0	128.5	3.1	2937.0	0.10	100.00

C Plane (°):0.0-360.0: 22.5
 Test Lab: Bacl
 Test Type: TYPE C
 Temperature: 25.3 'C
 Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0
 Test Device: GPM-3000
 Distance: 14.073 m
 Humidity: 48
 Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C22.5	C45.0	C67.5	C90.0	C112.5	C135.0	C157.5	C180.0	C202.5
G0.0	259.1	259.1	259.1	259.1	259.1	259.1	259.1	259.1	259.1	259.1
G5.0	257.0	260.0	267.4	274.2	277.2	276.3	270.1	263.4	258.4	253.6
G10.0	252.7	263.6	284.7	300.9	308.0	304.8	291.8	272.9	255.7	243.1
G15.0	246.3	267.8	299.8	324.0	336.1	330.5	310.4	282.0	250.7	226.0
G20.0	237.0	269.8	312.3	345.4	361.8	353.6	326.8	288.6	243.6	198.5
G25.0	225.7	269.6	322.5	364.5	384.2	374.8	340.4	291.6	234.4	151.1
G30.0	212.6	266.6	330.4	380.9	405.2	393.1	351.7	292.2	223.8	105.4
G35.0	197.8	261.5	335.7	394.5	423.4	408.7	360.1	290.8	211.3	93.7
G40.0	180.8	253.9	338.5	405.0	438.6	421.4	365.7	286.6	197.2	97.4
G45.0	162.7	244.5	338.3	412.9	449.9	430.2	368.7	280.3	181.6	120.2
G50.0	143.2	233.9	335.6	416.8	457.2	436.6	368.3	271.4	164.4	130.7
G55.0	123.1	221.0	330.2	418.3	461.3	439.5	365.4	260.8	146.5	118.4
G60.0	101.5	206.3	321.9	416.5	462.2	438.0	359.9	248.1	127.5	102.4
G65.0	78.3	190.0	311.0	412.0	459.2	433.1	352.4	233.6	107.7	86.5
G70.0	57.7	172.8	298.8	403.3	451.9	426.1	342.3	217.5	87.0	73.6
G75.0	42.4	154.8	285.8	391.4	441.7	416.6	329.5	200.3	66.7	61.9
G80.0	27.5	136.6	270.7	377.5	428.2	402.7	314.2	182.7	46.5	60.8
G85.0	13.5	117.2	253.4	360.0	413.5	383.7	296.5	164.0	26.9	74.1
G90.0	5.2	106.4	246.1	356.3	411.7	380.4	289.4	153.5	17.3	50.9
G95.0	17.1	121.4	259.2	366.0	420.0	389.7	300.2	168.9	35.8	43.6
G100.0	38.3	145.9	282.0	387.7	438.4	408.1	321.9	193.6	59.9	45.2
G105.0	61.5	169.1	302.1	407.7	455.4	426.3	341.4	215.8	84.6	62.4
G110.0	85.0	191.1	320.5	424.7	469.4	442.2	358.9	237.3	109.6	83.7
G115.0	110.0	212.3	336.8	437.0	480.7	453.5	373.2	257.2	134.3	105.5
G120.0	132.8	233.1	351.1	446.7	488.0	462.8	386.1	275.5	158.8	125.7
G125.0	150.4	252.5	362.6	452.4	492.2	468.1	395.6	291.5	182.0	147.3
G130.0	160.7	269.8	372.0	454.9	492.2	468.7	402.5	305.2	204.6	160.6
G135.0	168.8	285.1	378.5	454.0	487.4	466.1	406.0	316.3	222.3	123.8
G140.0	174.5	298.7	382.4	449.6	478.0	460.9	406.6	324.0	237.4	106.0
G145.0	178.2	309.9	383.3	442.2	465.8	451.4	403.4	312.5	249.4	104.9
G150.0	179.8	318.4	381.6	431.5	451.7	438.5	391.3	299.6	257.9	140.0
G155.0	191.4	323.7	377.4	417.8	435.4	422.8	357.5	299.5	265.8	182.6
G160.0	200.3	325.8	370.2	401.6	416.2	403.2	324.6	281.5	272.6	204.6
G165.0	219.3	300.7	360.0	383.2	394.8	369.9	293.0	271.3	260.1	217.5
G170.0	247.6	295.1	314.3	360.2	369.3	304.9	275.0	266.4	266.2	241.1
G175.0	278.2	290.4	294.0	277.5	335.5	224.1	270.4	283.3	278.1	274.0
G180.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

C Plane (°):0.0-360.0: 22.5
Test Lab: Bacl
Test Type: TYPE C
Temperature: 25.3 'C
Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0
Test Device: GPM-3000
Distance: 14.073 m
Humidity: 48
Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C225.0	C247.5	C270.0	C292.5	C315.0	C337.5	C360.0			
G0.0	259.1	259.1	259.1	259.1	259.1	259.1	259.1			
G5.0	245.3	235.1	231.0	234.1	241.2	249.9	257.0			
G10.0	208.5	145.9	119.0	131.9	187.6	232.7	252.7			
G15.0	119.2	103.9	118.5	107.8	96.3	199.1	246.3			
G20.0	99.3	173.9	218.0	196.9	105.8	131.6	237.0			
G25.0	137.1	216.5	226.5	219.9	181.6	79.5	225.7			
G30.0	187.5	207.8	218.7	211.4	194.8	75.5	212.6			
G35.0	183.4	197.8	210.4	201.6	185.0	105.1	197.8			
G40.0	171.9	188.8	203.8	193.8	173.0	145.9	180.8			
G45.0	158.7	182.3	196.1	186.9	162.9	141.5	162.7			
G50.0	147.5	170.2	184.8	174.6	154.0	127.9	143.2			
G55.0	137.1	159.8	177.9	165.6	141.3	113.9	123.1			
G60.0	123.8	154.0	173.3	159.2	130.2	100.5	101.5			
G65.0	116.8	151.5	175.1	156.7	124.3	89.7	78.3			
G70.0	114.0	157.7	183.5	162.1	122.8	76.7	57.7			
G75.0	120.7	176.1	206.7	180.6	128.5	73.2	42.4			
G80.0	135.6	374.2	452.7	407.6	142.0	76.8	27.5			
G85.0	179.2	283.1	338.7	291.6	200.1	146.0	13.5			
G90.0	153.8	235.7	296.5	256.7	172.3	71.7	5.2			
G95.0	122.5	179.2	223.4	197.1	136.2	46.3	17.1			
G100.0	80.3	133.9	191.5	161.5	70.6	33.1	38.3			
G105.0	67.9	109.9	119.8	103.7	71.8	55.6	61.5			
G110.0	86.8	89.3	106.5	90.8	83.8	74.3	85.0			
G115.0	105.4	115.9	121.1	112.4	100.5	98.1	110.0			
G120.0	127.7	131.2	143.3	132.0	122.6	119.8	132.8			
G125.0	149.2	155.5	163.2	154.7	146.1	140.4	150.4			
G130.0	169.8	178.8	187.7	178.2	168.8	160.7	160.7			
G135.0	189.2	200.6	210.7	200.9	189.1	179.6	168.8			
G140.0	206.9	220.6	231.3	221.5	207.8	195.5	174.5			
G145.0	217.8	237.9	250.5	239.5	225.1	144.4	178.2			
G150.0	215.9	251.8	266.1	256.1	239.6	105.8	179.8			
G155.0	129.8	247.4	279.0	268.1	227.4	102.3	191.4			
G160.0	96.4	156.9	267.1	231.0	130.3	171.5	200.3			
G165.0	160.6	99.2	132.2	127.4	126.9	198.9	219.3			
G170.0	222.6	164.8	135.4	190.9	198.2	221.0	247.6			
G175.0	263.0	227.9	142.5	189.1	230.9	252.7	278.2			
G180.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0			

C Plane (°):0.0-360.0: 22.5
Test Lab: Bacl
Test Type: TYPE C
Temperature: 25.3 'C
Operator: KOBE

Gamma Plane (°):0.0-180.0:5.0
Test Device: GPM-3000
Distance: 14.073 m
Humidity: 48
Inspector: